


## Submersible Mixer Stands

# Amamix / Amaprop

Submersible Mixer Stands for  
Amamix and Amaprop 1000  
Submersible Mixers

Installation Parts / Accessories

## Installation/Operating Manual

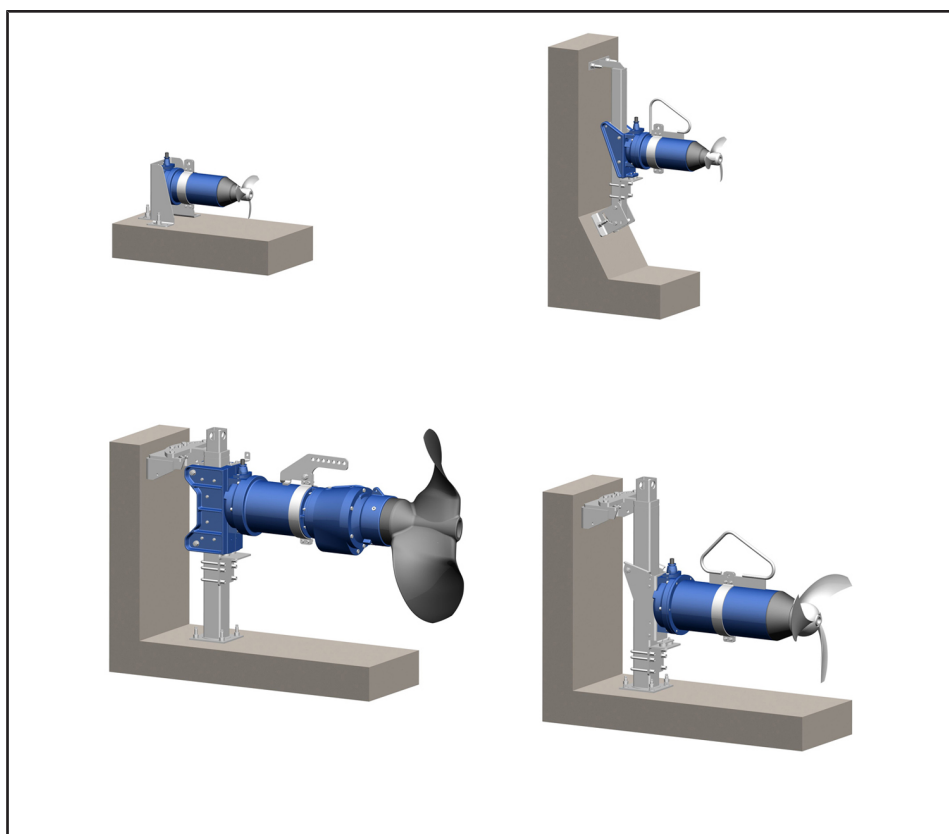

Mat. No.: 05153058

## **Legal information/Copyright**

Installation/Operating Manual Amamix / Amaprop

Original operating manual

All rights reserved. The contents provided herein must neither be distributed, copied, reproduced, edited or processed for any other purpose, nor otherwise transmitted, published or made available to a third party without the manufacturer's express written consent.

Subject to technical modification without prior notice.

© KSB SE & Co. KGaA, Frankenthal 17/02/2022

## Contents

	<b>Glossary .....</b>	<b>5</b>
<b>1</b>	<b>General.....</b>	<b>6</b>
1.1	Principles .....	6
1.2	Target group.....	6
1.3	Other applicable documents.....	6
1.4	Symbols .....	6
1.5	Key to safety symbols/markings.....	6
<b>2</b>	<b>Safety .....</b>	<b>8</b>
2.1	General.....	8
2.2	Intended use .....	8
2.3	Personnel qualification and personnel training.....	8
2.4	Consequences and risks caused by non-compliance with this manual .....	8
2.5	Safety awareness .....	9
2.6	Unauthorised modes of operation .....	9
<b>3</b>	<b>Transport/Storage/Disposal .....</b>	<b>10</b>
3.1	Transport.....	10
3.2	Storage/preservation .....	10
3.3	Return to supplier.....	11
3.4	Disposal .....	12
<b>4</b>	<b>Description.....</b>	<b>13</b>
4.1	General description .....	13
4.2	Product information as per Regulation No. 1907/2006 (REACH).....	15
4.3	Design details.....	15
4.4	Configuration and function.....	15
4.5	Scope of supply.....	16
4.6	Dimensions and weights .....	19
<b>5</b>	<b>Installation at Site .....</b>	<b>20</b>
5.1	Safety regulations.....	20
5.2	Prerequisites.....	20
5.3	Checks to be carried out prior to installation.....	20
5.3.1	Preparing the place of installation .....	20
5.4	Installing the submersible mixer stand .....	21
5.4.1	Preparing the installation position .....	21
5.4.2	Installing the submersible mixer stand - accessories 6.....	21
5.4.3	Installing the submersible mixer stand - accessories 7.....	22
5.4.4	Installing the submersible mixer stand - accessories 22.....	24
5.5	Mounting the submersible mixer on the submersible mixer stand.....	26
5.5.1	Fitting the guide bracket.....	26
5.5.2	Fitting the pitch adapter (optional).....	27
5.5.3	Fitting the supporting clamp, supporting strap or lifting bail.....	28
5.5.4	Transporting the submersible mixer .....	29
5.5.5	Setting the attachment point .....	30
5.5.6	Lifting rope.....	31
5.5.7	Fitting the submersible mixer to the submersible mixer stand.....	31
5.5.8	Fastening and tensioning the power cable.....	32
5.5.9	Fastening the lifting rope.....	32
5.5.10	Installing/handling lifting equipment (crane).....	32
5.5.11	Fitting the rope winder/bollard .....	33
<b>6</b>	<b>Commissioning/Start-up/Shutdown.....</b>	<b>34</b>
6.1	Commissioning/start-up .....	34
6.2	Shutdown.....	34

<b>7</b>	<b>Servicing/Maintenance .....</b>	<b>35</b>
7.1	Safety regulations.....	35
7.2	Servicing/inspection.....	36
7.3	Tightening torques.....	36
<b>8</b>	<b>Trouble-shooting.....</b>	<b>37</b>
<b>9</b>	<b>Related Documents .....</b>	<b>38</b>
9.1	General arrangement drawings .....	38
9.1.1	Installation of accessories 6 - Amamix 200 / 300 .....	38
9.1.2	Installation of accessories 7 - Amamix 200 / 300 .....	39
9.1.3	Installation of accessories 7 - Amamix 200 / 300 .....	40
9.1.4	Installation of accessories 22 - Amamix 200 / 300 / 400 (except size 4135) .....	41
9.1.5	Installation of accessories 22 - Amamix 200 / 300 / 400 (except size 4135) .....	42
9.1.6	Installation of accessories 22 - Amamix 200 / 300 / 400 (except size 4135) .....	43
9.1.7	Installation of accessories 22 - Amamix 400 (size 4135 only) / 600 .....	44
9.1.8	Installation of accessories 22 - Amamix 400 (size 4135 only) / 600 .....	45
9.1.9	Installation of accessories 22 - Amamix 400 (size 4135 only) / 600 .....	46
9.1.10	Installation of accessories 22 - Amamix 400 (size 4135 only) / 600 .....	47
9.1.11	General arrangement drawing of accessories 22 - Amaprop 1000 and 1380 .....	48
9.1.12	General arrangement drawing of accessories 22 - Amaprop 1000 and 1380 .....	49
9.1.13	Installation with upward pitch.....	50
9.1.14	Installation with downward pitch .....	51
<b>10</b>	<b>Certificate of Decontamination.....</b>	<b>52</b>
	<b>Index .....</b>	<b>53</b>



## Glossary

### Certificate of decontamination

A certificate of decontamination is enclosed by the customer when returning the product to the manufacturer to certify that the product has been properly drained to eliminate any environmental and health hazards arising from components in contact with the fluid handled.

### Submersible mixer

Submersible mixers are mixing units with open axial propeller hydraulics and an air-filled motor.

## 1 General

### 1.1 Principles

The installation/operating manual is valid for the type series and variants indicated on the front cover. The installation/operating manual describes proper and safe installation.

The name plate indicates the type series and size, the main operating data, the order number and the order item number. The order number and order item number clearly identify the installation part/accessories and serve as identification for all further business processes.

In the event of damage, immediately contact your nearest KSB Service centre to maintain the right to claim under warranty.

### 1.2 Target group

This operating manual is aimed at the target group of trained and qualified specialist technical personnel.


### 1.3 Other applicable documents

**Table 1:** Overview of other applicable documents

Document	Contents
Data sheet	Description of the technical data
General arrangement drawing/ Outline drawing	Description of mating and installation dimensions
General assembly drawing <sup>1)</sup>	Sectional drawing



### 1.4 Symbols

**Table 2:** Symbols used in this manual

Symbol	Description
✓	Conditions which need to be fulfilled before proceeding with the step-by-step instructions
▷	Safety instructions
⇒	Result of an action
⇔	Cross-references
1. 2.	Step-by-step instructions
	Note Recommendations and important information on how to handle the product






### 1.5 Key to safety symbols/markings

**Table 3:** Definition of safety symbols/markings

Symbol	Description
 <b>DANGER</b>	<b>DANGER</b> This signal word indicates a high-risk hazard which, if not avoided, will result in death or serious injury.
 <b>WARNING</b>	<b>WARNING</b> This signal word indicates a medium-risk hazard which, if not avoided, could result in death or serious injury.

1592.8217/01-EN

<sup>1</sup> If agreed to be included in the scope of supply

Symbol	Description
	<b>CAUTION</b> This signal word indicates a hazard which, if not avoided, could result in damage to the machine and its functions.
	<b>Explosion protection</b> This symbol identifies information about avoiding explosions in potentially explosive atmospheres in accordance with the <i>Equipment and Protective Systems Intended for use in Potentially Explosive Atmospheres Regulations 2016</i> .
	<b>General hazard</b> In conjunction with one of the signal words this symbol indicates a hazard which will or could result in death or serious injury.
	<b>Electrical hazard</b> In conjunction with one of the signal words this symbol indicates a hazard involving electrical voltage and identifies information about protection against electrical voltage.
	<b>Machine damage</b> In conjunction with the signal word CAUTION this symbol indicates a hazard for the machine and its functions.



## 2 Safety

All the information contained in this section refers to hazardous situations.

In addition to the present general safety information the action-related safety information given in the other sections must be observed.

### 2.1 General

- This operating manual contains general installation, operating and maintenance instructions that must be observed to ensure safe operation of the system and prevent personal injury and damage to property.
- Comply with all the safety instructions given in the individual sections of this operating manual.
- The operating manual must be read and understood by the responsible specialist personnel/operators prior to installation and commissioning.
- The contents of this operating manual must be available to the specialist personnel at the site at all times.
- The operator is responsible for ensuring compliance with all local regulations not taken into account.

### 2.2 Intended use

- The submersible mixer stand must only be operated within the operating limits described in the other applicable documents.
- Only use submersible mixer stands which are in perfect technical condition.
- Only use the submersible mixer stand in the fluid described in the data sheet or product literature.
- Consult the manufacturer about any other modes of use not described in the data sheet or product literature.
- Never exceed the permissible application and operating limits specified in the data sheet or product literature regarding temperature, etc.
- Observe all safety information and instructions in this manual.

### 2.3 Personnel qualification and personnel training

All personnel involved must be fully qualified to install, operate, maintain and inspect the equipment this manual refers to.

The responsibilities, competence and supervision of all personnel involved in transport, installation, operation, maintenance and inspection must be clearly defined by the operator.

Deficits in knowledge must be rectified by means of training and instruction provided by sufficiently trained specialist personnel. If required, the operator can commission the manufacturer/supplier to train the personnel.

Training must always be supervised by technical specialist personnel.

### 2.4 Consequences and risks caused by non-compliance with this manual

- Non-compliance with these operating instructions will lead to forfeiture of warranty cover and of any and all rights to claims for damages.
- Non-compliance can, for example, have the following consequences:
  - Hazards to persons due to electrical, thermal, mechanical and chemical effects and explosions
  - Failure of important product functions
  - Failure of prescribed maintenance and servicing practices
  - Hazard to the environment due to leakage of hazardous substances

### 2.5 Safety awareness

In addition to the safety information contained in this operating manual and the intended use, the following safety regulations shall be complied with:

- Accident prevention, health regulations and safety regulations
- Explosion protection regulations
- Safety regulations for handling hazardous substances
- Applicable standards, directives and laws


### 2.6 Unauthorised modes of operation

Never operate the submersible mixer stand outside the limits stated in the data sheet and in this installation and operating manual.

The warranty relating to the operating reliability and safety of the submersible mixer stand supplied is only valid if the stand is used in accordance with its intended use.


### 3 Transport/Storage/Disposal

#### 3.1 Transport

	<div style="background-color: #f4a460; padding: 5px;"><b>⚠ DANGER</b></div> <p><b>Improper transport</b>            Danger to life from parts falling or tipping over!            Damage to the submersible mixer stand!</p> <ul style="list-style-type: none"> <li>▷ Attach lifting accessories only to the attachment points provided.</li> <li>▷ Never use the lifting chain or lifting ropes included in KSB's scope of supply for lifting loads other than the KSB product supplied.</li> <li>▷ Safely attach lifting ropes or lifting chains to the attachment points and crane.</li> <li>▷ Always place submersible mixer stands, whether transported with or without a pallet, on solid and level ground.</li> <li>▷ Use suitable lifting accessories for the square guide rail.</li> </ul>
---	---

**Transport** Transport the submersible mixer stand in a horizontal position and in its original packaging (submersible mixer stand plus mixer strapped to the pallet) as shown.

Transport the submersible mixer stand with a fork-lift truck or pallet truck of sufficient load-carrying capacity.

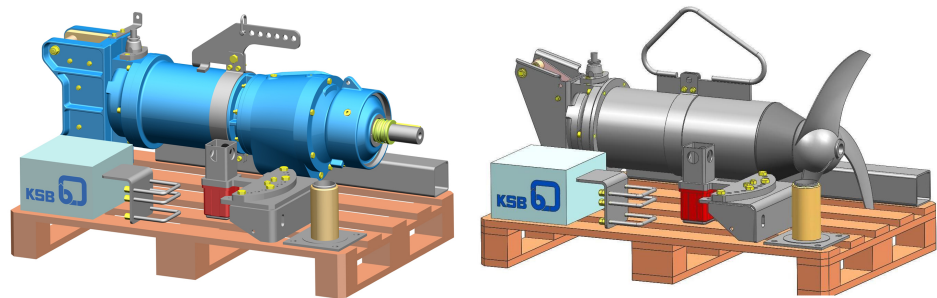

**Fig. 1:** Transporting the submersible mixer stand


**Placing in upright position** Use a crane of sufficient load-carrying capacity to place the submersible mixer stand in upright position.

	<div style="background-color: #f4a460; padding: 5px;"><b>⚠ DANGER</b></div> <p><b>Load may swing when pulled upright</b>            Danger to life from parts falling or toppling over!</p> <ul style="list-style-type: none"> <li>▷ Place the submersible mixer stand on solid and level ground only.</li> <li>▷ Keep lifting gear attached.</li> </ul>
---	--

1. Attach the lifting rope or chain to the crane.
2. Pull the lifting rope or chain taut.
3. Pull the submersible mixer stand upright.

#### 3.2 Storage/preservation

If commissioning is to take place some time after delivery, we recommend that the following measures be taken:

	<b>CAUTION</b> <b>Damage during storage by humidity, dirt, or vermin</b> Contamination of the submersible mixer stand! ▸ For outdoor storage cover the submersible mixer stand and accessories with waterproof material.
---	---

- Store the submersible mixer stand under dry and vibration-free conditions, if possible in its original packaging.
- Protect against ingress of rain water and dirt.
- Protect against frost.
- Avoid storing in direct sunlight.  
(material properties may be affected)

**Table 4:** Ambient conditions for storage



Ambient conditions	Value
Relative humidity	5 % to 85 % (non-condensing)
Ambient temperature	- 10 °C to + 50 °C

### 3.3 Return to supplier

1. Always flush and clean the submersible mixer stand, particularly if it has been used in noxious, explosive, hot or other hazardous fluids.
2. If the submersible mixer stand has been used in fluids leaving residues which might lead to corrosion when coming into contact with atmospheric humidity, or which might ignite when coming into contact with oxygen, the submersible mixer stand must also be neutralised and treated with anhydrous inert gas for drying purposes.
3. Always complete and enclose a certificate of decontamination when returning the submersible mixer stand.  
Always indicate any safety and decontamination measures taken.

	<b>NOTE</b> If required, a blank certificate of decontamination can be downloaded from the following web site: <a href="http://www.ksb.com/certificate_of_decontamination">www.ksb.com/certificate_of_decontamination</a>
---	--

### 3.4 Disposal


	 <b>WARNING</b>
	<p><b>Fluids posing a health hazard</b> Hazard to persons and the environment!</p> <ul style="list-style-type: none"> <li>▷ Submersible mixers used in fluids posing a health hazard must be decontaminated.</li> <li>▷ Collect and properly dispose of flushing liquid and any liquid residues.</li> <li>▷ Wear safety clothing and a protective mask, if required.</li> <li>▷ Observe all legal regulations on the disposal of harmful substances.</li> </ul>

1. Dismantle the submersible mixer.  
Collect greases and other lubricants during dismantling.
2. Separate and sort the materials, e.g. by:
  - Metals
  - Plastics
  - Electronic waste
  - Greases and lubricants
3. Dispose of materials in accordance with local regulations or in another controlled manner.

Electrical or electronic equipment marked with the adjacent symbol must not be disposed of in household waste at the end of its service life.

Contact your local waste disposal partner for returns.

If the used electrical or electronic equipment contains personal data, the operator is responsible for deleting it before the equipment is returned.








## 4 Description




### 4.1 General description



- Submersible mixer stand

Submersible mixers are used in waste water treatment plants for handling municipal and industrial waste water and sludges. The submersible mixer is installed in the tank on the submersible mixer stand.

**Table 5:** Installation types

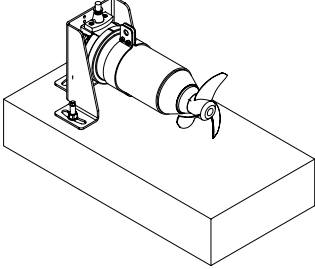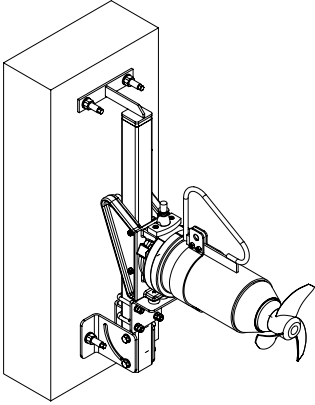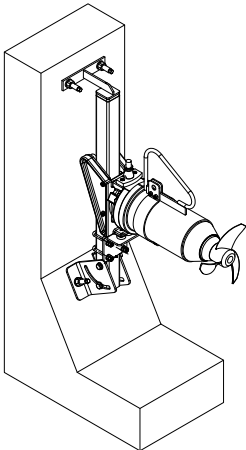Installation type	Illustration	Description
Floor-mounted		<ul style="list-style-type: none"> <li>▪ For Amamix 200 / 300 with accessories 6</li> <li>▪ Prerequisite: Place of installation is accessible (e.g. stormwater relief structures)</li> </ul>
Mounted on sump/tank wall		<ul style="list-style-type: none"> <li>▪ For Amamix 200 / 300 with accessories 7</li> <li>▪ Continuously adjustable installation depth with fixed jet direction. The submersible mixer can be lifted out of the tank or sump for maintenance and inspection work.</li> </ul>
Mounted on benching and sump/tank wall		<ul style="list-style-type: none"> <li>▪ For Amamix 200 / 300 with accessories 7</li> <li>▪ Special feature: continuously adjustable installation depth and adjustable jet direction. The submersible mixer can be lifted out of the tank or sump for maintenance and inspection work.</li> </ul>

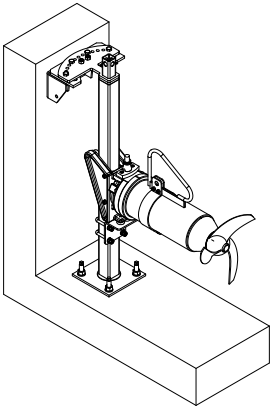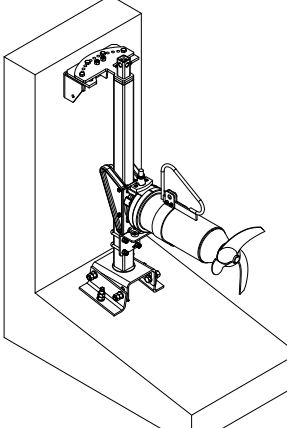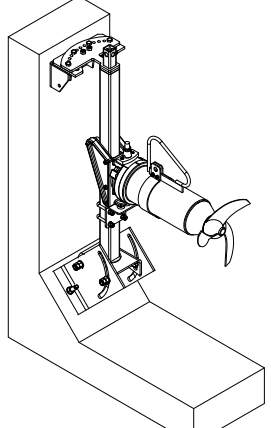Installation type	Illustration	Description
Mounted on the sump/tank wall and horizontal tank floor (inclined by 0 - 0.5°)		<ul style="list-style-type: none"> <li>For Amamix 200 - 600 and Amaprop 1000 with accessories 22</li> <li>Special feature: continuously adjustable installation depth and adjustable jet direction. The submersible mixer can be lifted out of the tank or sump for maintenance and inspection work.</li> </ul>
Mounted on the sump/tank wall and sloping tank floor (inclined by 0.5 - 10°)		<ul style="list-style-type: none"> <li>For Amamix 200 - 600 and Amaprop 1000 with accessories 22</li> <li>Special feature: continuously adjustable installation depth and adjustable jet direction. The submersible mixer can be lifted out of the tank or sump for maintenance and inspection work.</li> </ul>
Mounted on the sump/tank wall and on the inclined tank floor or on the sump/tank wall (inclined by 10 - 90°)		<ul style="list-style-type: none"> <li>For Amamix 200 - 600 and Amaprop 1000 with accessories 22</li> <li>Special feature: continuously adjustable installation depth and adjustable jet direction. The submersible mixer can be lifted out of the tank or sump for maintenance and inspection work.</li> </ul>

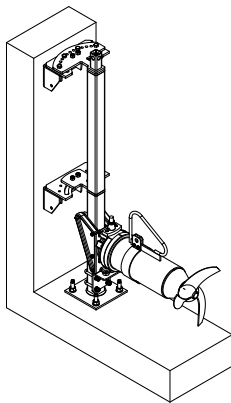Installation type	Illustration	Description
With middle support for guide rail		<ul style="list-style-type: none"> <li>For installation depths &gt; 6 m</li> </ul>
With pitch adapter		<ul style="list-style-type: none"> <li>For Amamix 200 - 600 and Amaprop 1000</li> <li>For upward or downward pitch adjustment in increments of 10° from 40° upwards to 40° downwards (Amamix 600 G 15° or 30° upward or downward pitch)</li> </ul>

#### 4.2 Product information as per Regulation No. 1907/2006 (REACH)

For information as per chemicals Regulation (EC) No. 1907/2006 (REACH), see <https://www.ksb.com/ksb-en/About-KSB/Corporate-responsibility/reach/>.

#### 4.3 Design details

##### Design

- Submersible mixer stand for mounting on the floor, coping or wall of a tank

##### Fastening

- The submersible mixer stand is fastened on the tank floor with chemical anchors.

##### Installation types

- Accessories 6
- Accessories 7
- Accessories 22

#### 4.4 Configuration and function

##### Design Accessories 6

- Submersible mixer stand consisting of a stand for mounting on the tank floor
- Material 1.4301 or 1.4571

##### Accessories 7 and 22

- Submersible mixer stand consisting of a square guide rail, upper and lower holders and a retaining bracket.
- Material 1.4301 or 1.4571
- Square guide rail
  - For Amamix 200 / 300: cross-section 60 x 60, wall thickness 3 mm

- For Amamix 400 / 600: cross-section 100 x 100, wall thickness 5 mm
- Amaprop 1000: cross-section 100 x 100, wall thickness 5 mm


**Function** The submersible mixer stand is designed to absorb all forces and moments generated during mixer operation and transfer them to the foundation.

#### 4.5 Scope of supply


Depending on the model, the following items are included in the scope of supply:

##### Accessories 6

- Stand for floor mounting



- Chemical anchors




- 5 x UPAT chemical mortar



##### Accessories 7

- Chemical anchors




- Square guide rail with guide rail extension (if applicable)




- Lower holder for mounting on the sump/tank wall or benching




- Upper holder



- Retaining bracket




- Guide bracket  
Version C or version G,  
usually supplied fitted to the mixer

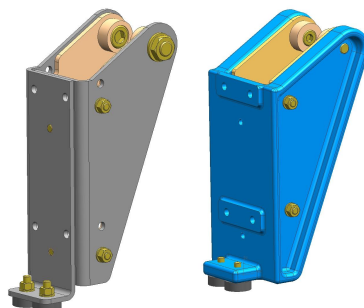

#### Accessories 22


- Chemical anchors




- Guide rail  
with guide rail extension (if applicable)




- Lower holder  
for mounting on a horizontal tank floor ( $0^\circ - 0.5^\circ$ )  
Version 60 x 60 or 100 x 100 mm

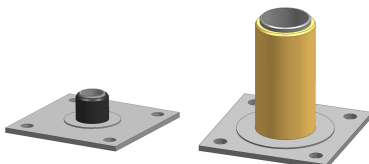


- Lower holder  
for mounting on a sloping tank floor ( $0.5^\circ - 10^\circ$ )




- Lower holder  
for mounting on an inclined tank floor or on the sump/tank wall ( $10^\circ - 90^\circ$ )




- Upper holder  
Version 60 x 60 or 100 x 100 mm




- Retaining bracket  
Version 60 x 60 or 100 x 100 mm

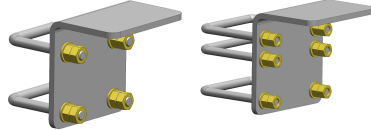

- Guide bracket  
Version C or version G, or - for Amaprop 1000 - with individual rollers usually supplied fitted to the mixer

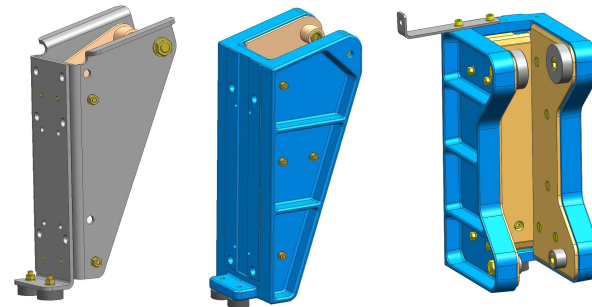

## Special accessory - Middle support for guide rail



## Special accessory - Supporting strap (Amamix only)

Fastened to the mixer via the supporting clamp if a pitch adapter is used; usually fitted at the factory



## Special accessory - Lifting bail (Amamix only)

Fastened to the mixer via the supporting clamp; usually fitted at the factory




## Special accessory - Pitch adapter (Amamix only)

Usually fitted between the motor housing cover and the guide bracket at the factory



**Special accessory - Pitch adapter for Amamix 600 G**

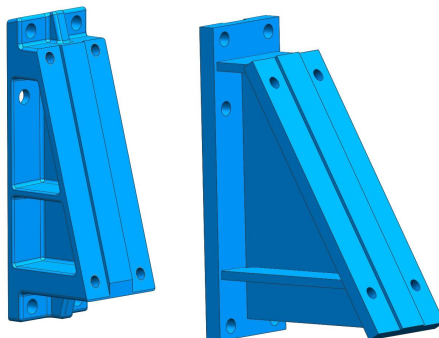

Usually fitted between the motor housing cover and the guide bracket at the factory

**4.6 Dimensions and weights**

For dimensions and weights please refer to the general arrangement drawing/outline drawing or data sheet.

## 5 Installation at Site

### 5.1 Safety regulations

	<div style="background-color: #f4a460; padding: 5px;"> <b>DANGER</b></div> <p><b>Improper installation in potentially explosive atmospheres</b> Explosion hazard! Damage to the submersible mixer stand!</p> <ul style="list-style-type: none"> <li>▸ Comply with the applicable local explosion protection regulations.</li> <li>▸ Observe the information given in the data sheet and on the name plate.</li> </ul>
---	--



### 5.2 Prerequisites

Installation of the submersible mixer stand requires:

- At least two fitters
- Suitable lifting equipment of sufficient load-carrying capacity with approved lifting tackle
- Portable drill with hard metal drill bit (better: core drill bit)
  - Ø 18 mm, hole depth 125 mm - for fitting the upper and lower guide rail holders
  - Ø 12 mm, hole depth 90 mm - for fitting the bollard
- Metal drill bit
  - Ø 13 mm - for preparing the square guide rail
- Compressed air for cleaning the drilled holes
- Open-jawed or ring spanner for hexagon head bolt M12 (WAF19), M16 (WAF24)
- Torque wrench
- Cut-off grinder for cutting the square guide rail to length
- Welding unit for welding on a guide rail extension (if required)

### 5.3 Checks to be carried out prior to installation

#### 5.3.1 Preparing the place of installation

	<div style="background-color: #f4a460; padding: 5px;"> <b>WARNING</b></div> <p><b>Installation on foundations which are unsecured and cannot support the load</b> Personal injury and damage to property!</p> <ul style="list-style-type: none"> <li>▸ Make sure the foundation concrete is of sufficient strength (min. C20/25 to DIN 1045).</li> <li>▸ Only place the submersible mixer stand on a foundation whose concrete has set firmly.</li> <li>▸ Refer to the weights given in the data sheet / on the name plate.</li> </ul>
---	---

1. Check structural requirements.  
All structural work required must have been prepared in accordance with the dimensions stated in the outline drawing/general arrangement drawing.
2. Clean the concrete surface; if required, clean with a broom to remove any loose particles.



## 5.4 Installing the submersible mixer stand

### 5.4.1 Preparing the installation position

1. Mark the installation position inside the tank as shown in the site layout drawing.

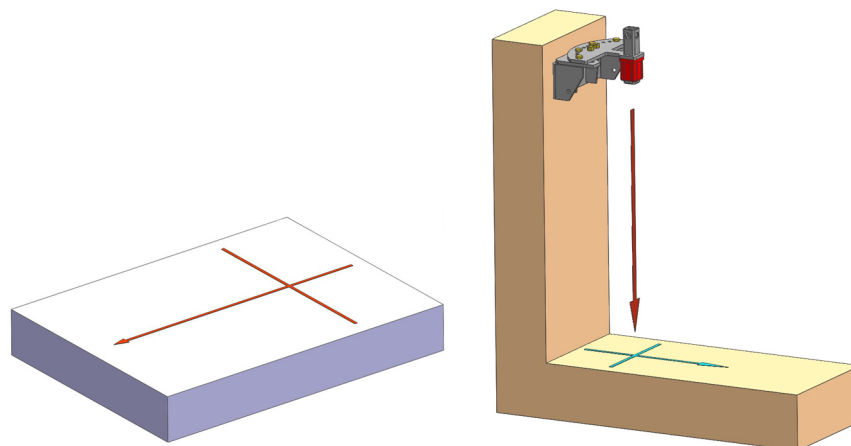


Fig. 2: Marking the installation position

### 5.4.2 Installing the submersible mixer stand - accessories 6

#### 5.4.2.1 Setting up and fastening the submersible mixer stand

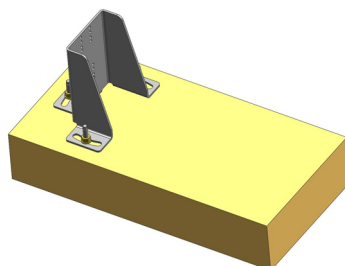


Fig. 3: Setting up and fastening the submersible mixer stand

✓ The installation position has been prepared. (⇒ Section 5.4.1, Page 21)

1. Place the submersible mixer stand on the marked-out area.
2. Drill holes for the chemical anchors.
3. To ensure optimum contact between the stand and the concrete floor, apply the chemical mortar in the installation position area (⇒ Section 4.5, Page 16) with a cartridge press.  
Work quickly, bearing in mind the curing time of the chemical mortar. Observe the manufacturer's application instructions.
4. Position the stand in the soft chemical mortar in the marked installation position.
5. Insert the mortar cartridges into the drilled holes.
6. Crack the fitted mortar cartridges open with a threaded rod.  
Work quickly, bearing in mind the curing time of the chemical mortar. Observe the manufacturer's application instructions.
7. Screw the stand on with chemical anchors.  
Observe the processing time of the two-pack resin! Observe the information on the packaging of the mortar cartridges.
8. Tighten the chemical anchors. (⇒ Section 7.3, Page 36)

### 5.4.3 Installing the submersible mixer stand - accessories 7

#### 5.4.3.1 Preparing the guide rail

1. Mark the required length on the guide rail, if necessary.
2. If required, shorten the guide rail with a 90° cut at a suitable workplace.
3. Deburr the edges, if necessary.
4. If necessary, drill holes for the lower holder into the guide rail, as shown.

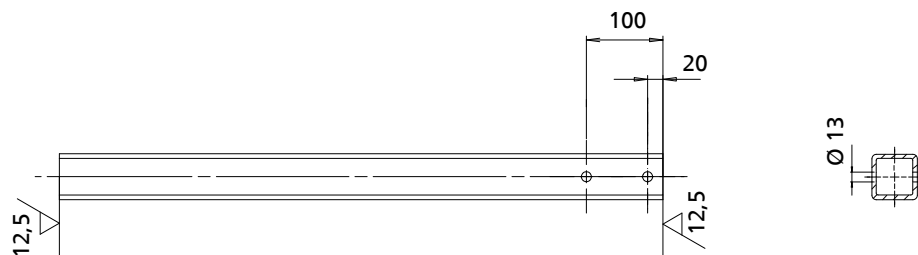


Fig. 4: Preparing the guide rail

#### 5.4.3.2 Fitting the lower holder


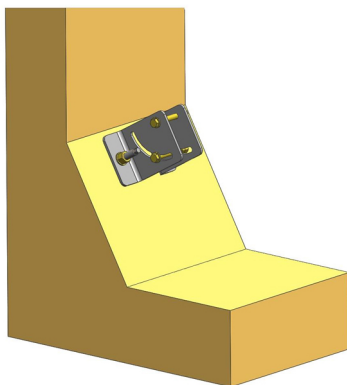


Fig. 5: Fitting the lower holder

✓ The installation position has been prepared. (⇒ Section 5.4.1, Page 21)

1. Place the lower holder on the marked-out area.
2. Drill the holes for the chemical anchors.
3. Insert the mortar cartridges into the drilled holes.
4. Crack the fitted mortar cartridges open with a threaded rod.  
Work quickly, bearing in mind the curing time of the chemical mortar. Observe the manufacturer's application instructions.
5. Fasten the holder by screwing in the chemical anchors.  
Observe the processing time of the two-pack resin. Observe the information on the packaging of the mortar cartridges.
6. Tighten the chemical anchors. (⇒ Section 7.3, Page 36)


### 5.4.3.3 Setting up and fastening the guide rail

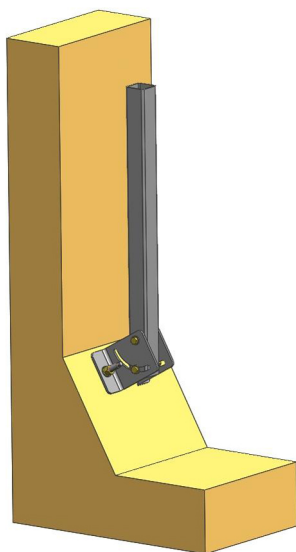

**Fig. 6:** Setting up and fastening the guide rail

- ✓ The guide rail has been cut to the required length. (⇒ Section 5.4.3.1, Page 22)
  - ✓ The lower holder has been mounted. (⇒ Section 5.4.3.2, Page 22)
1. Place the guide rail into the lower holder.
  2. Bolt the lower holder to the guide rail.


### 5.4.3.4 Fitting the upper holder to the guide rail

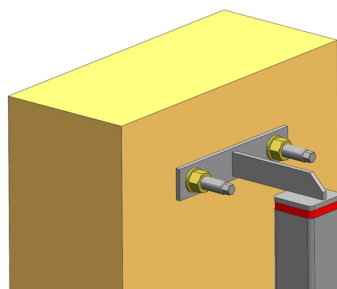

**Fig. 7:** Fitting the upper holder to the guide rail

- ✓ The guide rail has been cut to the required length.
  - ✓ The guide rail has been placed in position and fastened to the lower holder.
1. Place the upper holder into the guide rail.
  2. Drill the holes for the chemical anchors.
  3. Insert the mortar cartridges into the drilled holes.
  4. Crack the fitted mortar cartridges open with a threaded rod.  
Work quickly, bearing in mind the curing time of the chemical mortar. Observe the manufacturer's application instructions.
  5. Fasten the holder by screwing in the chemical anchors.  
Observe the processing time of the two-pack resin. Observe the information on the packaging of the mortar cartridges.
  6. Tighten the chemical anchors. (⇒ Section 7.3, Page 36)

#### 5.4.3.5 Fitting the retaining bracket

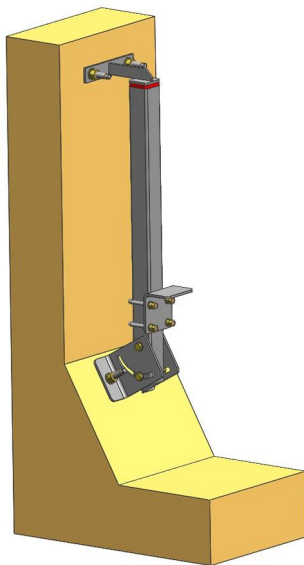

**Fig. 8:** Fitting the retaining bracket


- ✓ The guide rail has been placed in position and fastened.  
(⇒ Section 5.4.3.3, Page 23)
- 1. Fasten the retaining bracket to the guide rail using stirrup bolts and lock nuts.  
Observe the required distance from the floor.

#### 5.4.4 Installing the submersible mixer stand - accessories 22

##### 5.4.4.1 Preparing the guide rail

1. Mark the required length on the guide rail, if necessary, taking into account the position of the middle support, if any.
2. If required, shorten the guide rail with a 90° cut at a suitable workplace.
3. Deburr the edges, if necessary.


##### 5.4.4.2 Fitting the lower holder

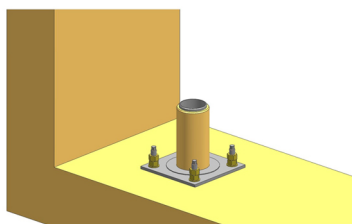

**Fig. 9:** Fitting the lower holder

- ✓ The installation position has been prepared. (⇒ Section 5.4.1, Page 21)
- 1. Place the lower holder on the marked-out area.
- 2. Drill holes for the chemical anchors.
- 3. Crack the fitted mortar cartridges open with a threaded rod.  
Work quickly, bearing in mind the curing time of the chemical mortar. Observe the manufacturer's application instructions.
- 4. Screw the holder on with chemical anchors.  
Observe the processing time of the two-pack resin! Observe the information on the packaging of the mortar cartridges.
- 5. Tighten the chemical anchors. (⇒ Section 7.3, Page 36)


### 5.4.4.3 Setting up and fastening the guide rail

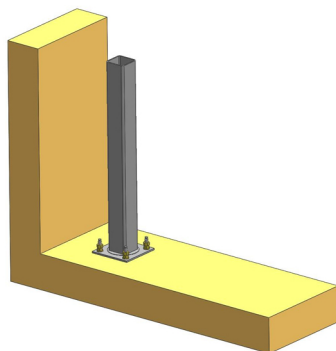

**Fig. 10:** Setting up and fastening the guide rail

- ✓ The guide rail has been cut to the required length. (⇒ Section 5.4.4.1, Page 24)
- ✓ The lower holder has been mounted. (⇒ Section 5.4.4.2, Page 24)
- 1. Place the guide rail onto the lower holder.  
(Guide rail is not bolted to the lower holder.)


### 5.4.4.4 Fitting the middle support to the guide rail (optional)

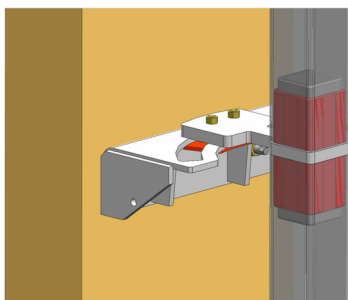

**Fig. 11:** Fitting the middle support to the guide rail

- ✓ Installation depth > 6 m.
- 1. Take the guide rail out of the lower holder.
- 2. Place the guide rail in a suitable assembly area.
- 3. Cut the guide rail at the level of the middle support.
- 4. Debur the cut edges if necessary.
- 5. Place one half of the guide rail onto the lower holder.
- 6. Insert the middle support into the guide rail.
- 7. Drill the holes for the chemical anchors.
- 8. Bolt the middle support to the tank wall.
- 9. Place the second half of the guide rail onto the middle support.


#### 5.4.4.5 Fitting the upper holder to the guide rail

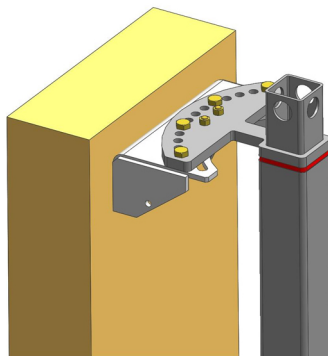

**Fig. 12:** Fitting the upper holder to the guide rail

- ✓ The guide rail has been cut to the required length.
- ✓ The guide rail has been placed in position and fastened to the lower holder.
  1. Place the upper holder into the guide rail.
  2. Drill the holes for the chemical anchors.
  3. Bolt the upper holder to the tank wall.

#### 5.4.4.6 Fitting the retaining bracket

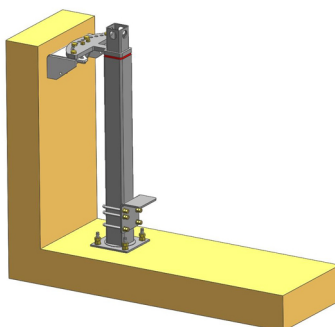


**Fig. 13:** Fitting the retaining bracket

- ✓ The guide rail has been placed in position and fastened.  
(⇒ Section 5.4.4.3, Page 25)
- 1. Fasten the retaining bracket to the guide rail using stirrup bolts and lock nuts, observing the required distance from the floor.

### 5.5 Mounting the submersible mixer on the submersible mixer stand

#### 5.5.1 Fitting the guide bracket

Usually, the submersible mixer comes with the guide bracket 732 already fitted at the factory.

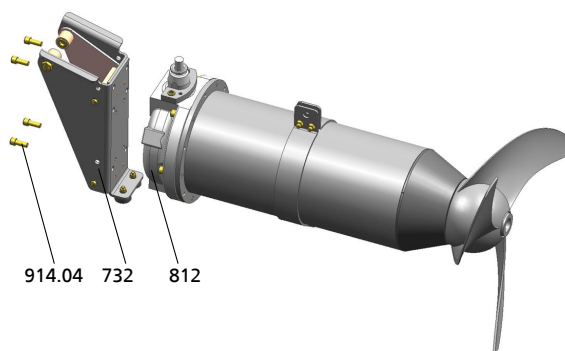

**Fig. 14:** Fitting the guide bracket to the submersible mixer


✓ The guide bracket 732 has not yet been fitted to the submersible mixer.

1. Fit guide bracket 732 to motor housing cover 812 using four hex. socket head cap screws 914.04.

### 5.5.2 Fitting the pitch adapter (optional)

Usually, the submersible mixer comes with the guide bracket 732 and the pitch adapter 82-5 already fitted at the factory.

Amamix 600 G comes with a wedge-shaped cast component (15° or 30° angle piece) fitted between the guide bracket and the motor housing cover and coated together with the mixer.

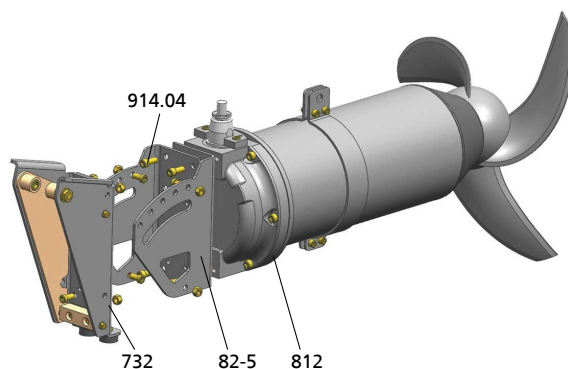


**Fig. 15:** Fitting the pitch adapter and guide bracket to the submersible mixer

✓ Guide bracket 732 and pitch adapter 82-5 have not yet been fitted to the submersible mixer.


1. Fasten pitch adapter 82-5 to motor housing cover 812 with four hexagon socket head cap screws 914.04.  
The version shown has an upward pitch. For a downward pitch the two angle pieces of the pitch adapter must be turned through 180°.
2. Using the hexagon socket head cap screws, fit guide bracket 732 to pitch adapter 82-5 in such a way that the required upward or downward pitch is achieved.

### 5.5.3 Fitting the supporting clamp, supporting strap or lifting bail


- a) Amamix with supporting clamp

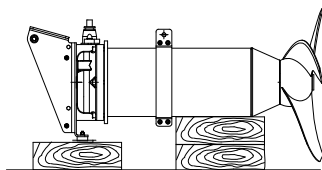


- b) Amamix with supporting strap

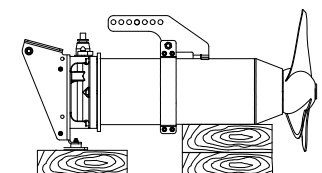

- c) Amamix with lifting bail

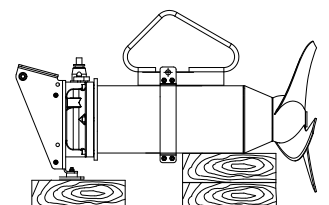

- d) Amaprop 1000 with supporting strap

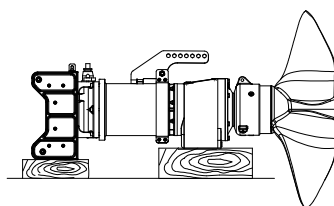


The submersible mixer usually comes with the supporting clamp, supporting strap or lifting bail already fitted in centre of gravity position at the factory.


1. Position the submersible mixer as shown.
2. Fit the supporting clamp, supporting strap or lifting bail using hexagon head bolts.  
Observe the tightening torques! (⇒ Section 7.3, Page 36)




### 5.5.4 Transporting the submersible mixer

	<p><b>⚠ DANGER</b></p>
	<p><b>Improper transport</b>            Danger to life from falling parts!            Damage to the submersible mixer!</p> <ul style="list-style-type: none"> <li>▷ Use the attachment point provided (lifting lug or bail) for attaching lifting accessories.</li> <li>▷ Never suspend the submersible mixer by its power cable.</li> <li>▷ Never use the lifting ropes included in KSB's scope of supply for lifting loads other than the KSB product supplied.</li> <li>▷ Safely attach lifting ropes to the submersible mixer and crane.</li> <li>▷ Protect the power cable against damage.</li> <li>▷ Maintain adequate safety distance during lifting operations.</li> </ul>


Transport the submersible mixer as shown.

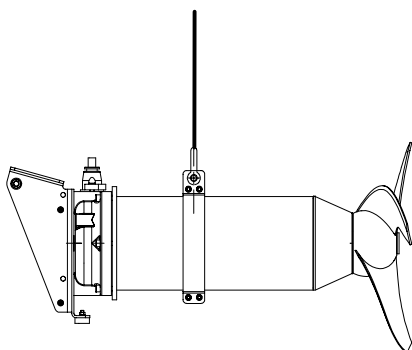


Transport with supporting clamp

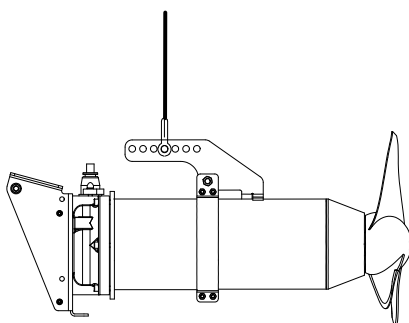

Transport with supporting strap

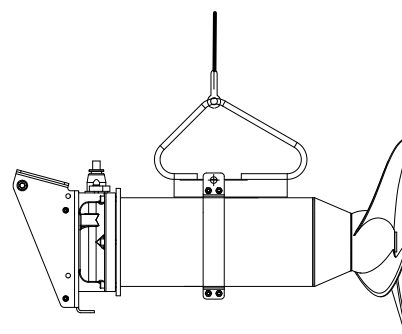

Transport with lifting bail

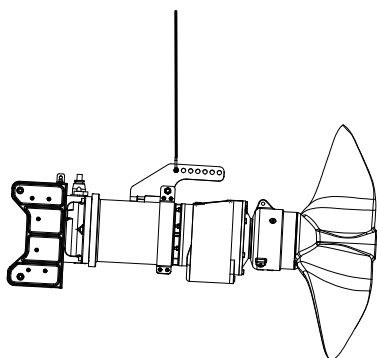

Transport with supporting strap

### 5.5.5 Setting the attachment point

The correct attachment point must be selected in order to ensure reliable installation and problem-free lifting and lowering of the submersible mixer on the submersible mixer stand.

#### Amamix

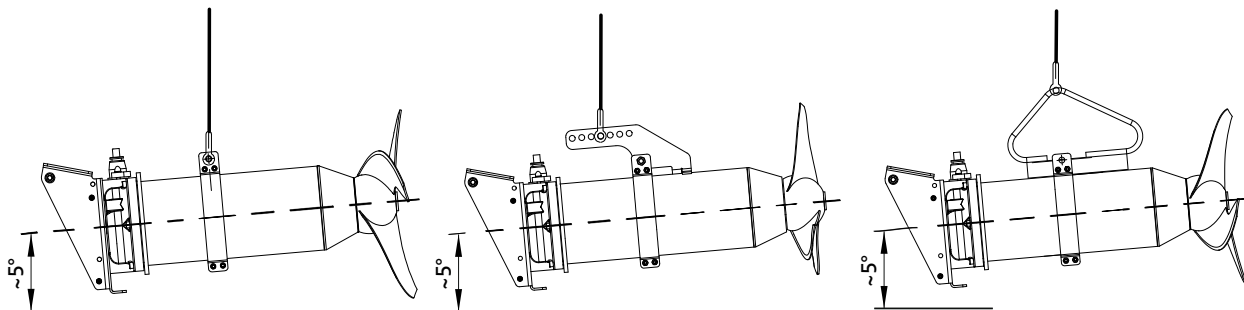



Fig. 16: Attachment point Amamix

For trouble-free lifting and lowering, an inclination angle of approx. 5° must be maintained (higher end = propeller end).<sup>2)</sup> If the angle deviates from the requirements, the attachment point must be corrected.

Correcting the attachment point:

1. Slightly loosen the bolts on supporting clamp 59-31.
2. Shift supporting clamp 59-31 depending on the inclination angle.

	<div style="background-color: yellow; padding: 5px;"><b>CAUTION</b></div> <p><b>Loose or insufficiently tight screw connections</b> Damage to the installation parts during operation</p> <p>▸ Observe the tightening torques.</p>
---	--

3. Re-tighten all bolts.  
Observe the tightening torques. (⇒ Section 7.3, Page 36)

4. Repeat attachment procedure.

⇒ If the angle of inclination is approx. 5°, the correct centre of gravity position has been found.<sup>2)</sup>

<sup>2)</sup> If a pitch adapter is used the inclination angle will change accordingly.

### Amaprop 1000

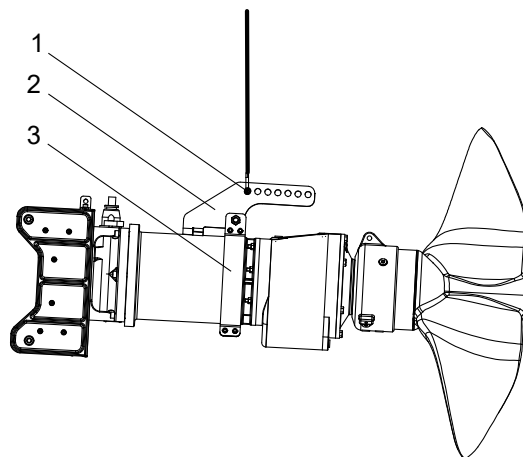


Fig. 17: Adjusting the attachment point for Amaprop 1000

1	Attachment point	2	Supporting strap
3	Supporting clamp		

To ensure problem-free lifting and lowering, the mixer must be slightly inclined when suspended by the supporting strap (lower end = propeller end). If the angle deviates from the requirements, the attachment point must be corrected.

Correcting the attachment point:

The supporting clamp is mounted at the factory as shown; its position must not be changed.

The correct attachment point is set by selecting the correct hole in the supporting strap (first hole of the supporting strap counted from the guide rail side).

#### 5.5.6 Lifting rope

For lifting/lowering with lifting equipment, the lifting rope can also be attached directly at the attachment point. It can remain attached during operation.

#### 5.5.7 Fitting the submersible mixer to the submersible mixer stand

##### Accessories 6

- ✓ The submersible mixer stand has been installed. (⇒ Section 5.4, Page 21)
  1. Place the submersible mixer onto the submersible mixer stand.
  2. Bolt the submersible mixer to the submersible mixer stand.

##### Accessories 7 and 22



- ✓ The submersible mixer stand has been installed. (⇒ Section 5.4, Page 21)
- ✓ The supporting clamp, supporting strap or lifting bail has been fitted to the submersible mixer.
- ✓ Centre of gravity position has been ensured.
  1. Suspend the submersible mixer from the lifting gear and position it over the square guide rail.
  2. Lower the submersible mixer onto the square guide rail.
  3. Lower the submersible mixer down the square guide rail into the tank until the rubber buffer on the guide bracket rests on the retaining bracket and the submersible mixer has assumed its operating position.




#### NOTE

To make it easier to locate the position of the submersible mixer at a later point, the rope should be marked at the railing level.

### 5.5.8 Fastening and tensioning the power cable

	<p><b>! DANGER</b></p> <p><b>Power cable not properly routed</b> Risk of injury! Risk of falling!</p> <ul style="list-style-type: none"> <li>▷ Route the power cable in such a way that it cannot pull down any persons if the pump set falls down or is lowered down.</li> </ul>
	<p><b>CAUTION</b></p> <p><b>Power cable routed with too much slack</b> Damage to power cable by axial propeller !</p> <ul style="list-style-type: none"> <li>▷ Pull the power cable taut before fastening it at the tank edge.</li> </ul>




**Fig. 18:** Fastening and tensioning the power cable

1	Carabine hook	2	Cable support
---	---------------	---	---------------

If possible, the power cable should be fastened to the tank edge at a distance of approx. 0.8 m from the side of the guide rail, to prevent chafing on the guide rail, which would damage the power cable.

1. Fit the cable support to the power cable at the tank edge and use a carabine hook to attach it to an appropriate point (e.g. railing or eyebolt).
2. Pull the power cable taut up to the tank edge before tightening the cable support bolts.  
Prevent chafing of the power cable (use appropriate pads at the tank edge, if necessary).


### 5.5.9 Fastening the lifting rope

	<p><b>CAUTION</b></p> <p><b>Slack lifting ropes</b> Damage to lifting ropes by propeller blades!</p> <ul style="list-style-type: none"> <li>▷ When using a stationary crane mounted at the mixer's installation position, ensure that the rope is routed up to the winch with a minimum of slack during mixer operation.</li> </ul>
---	---

### 5.5.10 Installing/handling lifting equipment (crane)


If a crane is included in the scope of supply, the accompanying set of crane operating instructions must be observed.

### 5.5.11 Fitting the rope winder/bollard



**Fig. 19: Rope winder/bollard (RB)**

When using transportable cranes, the lifting rope is removed from the winch of the lifting equipment after the submersible mixer has been lowered into the tank. The lifting rope is then securely tied around the rope winder/bollard.

	<div style="background-color: #FFD700; padding: 5px;"><b>CAUTION</b></div> <p><b>Loose or slack lifting rope</b> Damage to the lifting rope!</p> <ul style="list-style-type: none"> <li>▷ With the system in its normal operating position, the lifting rope must be unstressed yet without excessive slack.</li> <li>▷ Securely fasten the lifting rope. Use a rope winder/bollard or other rope fastening equipment if necessary.</li> </ul>
---	--

1. Position the rope winder/bollard at the edge of the tank, e.g. beneath the railing, and fasten it with chemical anchors M10 x 130 or M10 bolts.
2. Run the end of the lifting rope through a stirrup bolt on the rope winder and pull it through completely.
3. Secure the lifting rope with the M5 stirrup bolt.  
Observe the tightening torques. (⇒ Section 7.3, Page 36)
4. Wind the rope around the two sheet metal brackets.
5. Secure the lifting rope against unintentional unwinding with the second M5 stirrup bolt.  
Observe the tightening torques. (⇒ Section 7.3, Page 36)

Alternatively, the rope winder/bollard can also be fastened to the railing.



## 6 Commissioning/Start-up/Shutdown

### 6.1 Commissioning/start-up

Before start-up, the following requirements must be met:

- The submersible mixer stand has been installed as specified in this manual.
- All screws and bolts have been tightened as specified in this manual.
- Compliance with all items of the operating manual of the submersible mixer has been verified.

### 6.2 Shutdown

	<div style="background-color: #f4a460; padding: 5px; border: 1px solid black; margin-bottom: 5px;">  <b>WARNING</b> </div> <p><b>Fluids posing a health hazard</b> Hazardous to persons and the environment!</p> <ul style="list-style-type: none"> <li>▷ Submersible mixer stands used in fluids posing a health hazard must be decontaminated.</li> <li>▷ Wear safety clothing and a protective mask, if required.</li> <li>▷ Observe all legal regulations on the disposal of harmful substances.</li> </ul>
---	--










#### Submersible mixer stand is taken out of service



- ✓ All safety regulations are observed.
1. Clean the submersible mixer stand.
  2. Carry out maintenance work.

## 7 Servicing/Maintenance

### 7.1 Safety regulations

The operator ensures that maintenance, inspection and installation are performed by authorised, qualified specialist personnel who are thoroughly familiar with the manual.

	<div data-bbox="507 414 683 459"> <b>DANGER</b></div> <p><b>Sparks produced during maintenance work</b> Explosion hazard!</p> <ul style="list-style-type: none"> <li>▷ Always perform maintenance work on explosion-proof submersible mixers outside potentially explosive atmospheres only.</li> </ul>
	<div data-bbox="507 649 683 694"> <b>DANGER</b></div> <p><b>Improper transport</b> Danger to life from falling parts! Damage to the submersible mixer!</p> <ul style="list-style-type: none"> <li>▷ Use the attachment point provided (lifting lug or bail) for attaching lifting accessories.</li> <li>▷ Never suspend the submersible mixer by its power cable.</li> <li>▷ Never use the lifting ropes included in KSB's scope of supply for lifting loads other than the KSB product supplied.</li> <li>▷ Safely attach lifting ropes to the submersible mixer and crane.</li> <li>▷ Protect the power cable against damage.</li> <li>▷ Maintain adequate safety distance during lifting operations.</li> </ul>
	<div data-bbox="507 1153 702 1198"> <b>WARNING</b></div> <p><b>Submersible mixer started up unintentionally</b> Risk of injury by moving parts!</p> <ul style="list-style-type: none"> <li>▷ Always make sure the electrical connections are disconnected before carrying out work on the submersible mixer.</li> <li>▷ Make sure that the submersible mixer cannot be started up unintentionally.</li> </ul>
	<div data-bbox="507 1433 702 1478"> <b>WARNING</b></div> <p><b>Fluids handled and supplies posing a health hazard or hot fluids handled and supplies</b> Risk of injury!</p> <ul style="list-style-type: none"> <li>▷ Observe all relevant laws.</li> <li>▷ Take appropriate measures to protect persons and the environment.</li> <li>▷ Decontaminate submersible mixers used in fluids posing a health hazard.</li> </ul>
	<div data-bbox="507 1758 587 1792"><b>NOTE</b></div> <p>Special regulations apply to repair work on explosion-proof submersible mixers. Modification or alteration of the submersible mixers could affect explosion protection and is only permitted after consulting the manufacturer.</p>

	<p><b>NOTE</b></p> <p>A regular maintenance schedule will help avoid expensive repairs and contribute to trouble-free, reliable operation with a minimum of maintenance expenditure and work.</p>
	<p><b>NOTE</b></p> <p>All maintenance work, service work and installation work can be carried out by KSB Service or authorised workshops. For contact details refer to the enclosed "Addresses" booklet or visit "<a href="http://www.ksb.com/contact">www.ksb.com/contact</a>" on the Internet.</p>

Never use force when dismantling and reassembling the submersible mixer.

## 7.2 Servicing/inspection

**Visual inspection** Visual inspection of submersible mixer stand and secure floor mounting (chemical anchors).

**When tank is filled:**

- Check condition of upper holder.
- Check the supporting strap and/or lifting bail and the connected parts for wear.
- Verify that the bolt of the shackle (if any) is firmly tightened.
- Check the condition of the flexible element between the upper holder and the guide rail.
- Verify that all screws/bolts and the chemical anchors are firmly seated.

**When tank is empty:**

- Visual inspection of the submersible mixer stand and (if applicable) the middle support.
- Check the floor mounting fastened with chemical anchors.
- Check the condition of the square guide rail and the surfaces supporting the mixer.
- Check the firm seating and full load-carrying capacity of the retaining bracket.

**Checking the tightening torques** Verify that all screwed/bolted connections have been tightened to the torques specified in the manual.



## 7.3 Tightening torques

**Table 6:** Tightening torques

Thread	[Nm]
M5	4
M8	17
M10	35
M12	60
M16	150
Chemical anchors	60



## 8 Trouble-shooting

	 <b>WARNING</b>
	<b>Improper work to remedy faults</b> Risk of injury! <p>► For any work performed to remedy faults, observe the relevant information given in this operating manual and/or in the product literature provided by the accessories manufacturer.</p>

If problems occur that are not described in the following table, consultation with the KSB service is required.

- A** Submersible mixer does not generate flow
- B** Insufficient flow
- C** Submersible mixer is hard to install or remove
- D** Vibrations and noise during mixer operation

**Table 7:** Trouble-shooting

A	B	C	D	Possible cause	Remedy
<b>X</b>	-	-	-	Slack power cable has been destroyed by propeller.	Replace power cable and install it without slack as per operating manual
-	-	<b>X</b>	-	Guide rail not vertical	Check and correct; tank needs to be drained.
-	-	-	<b>X</b>	Submersible mixer stand incorrectly fastened	Check and correct; tank needs to be drained.
-	-	-	<b>X</b>	Submersible mixer incorrectly fastened to submersible mixer stand	Check and correct; tank needs to be drained.

## 9 Related Documents

### 9.1 General arrangement drawings

#### 9.1.1 Installation of accessories 6 - Amamix 200 / 300

For permanent mounting on the tank floor  
(sizes 400 and 600 on request)

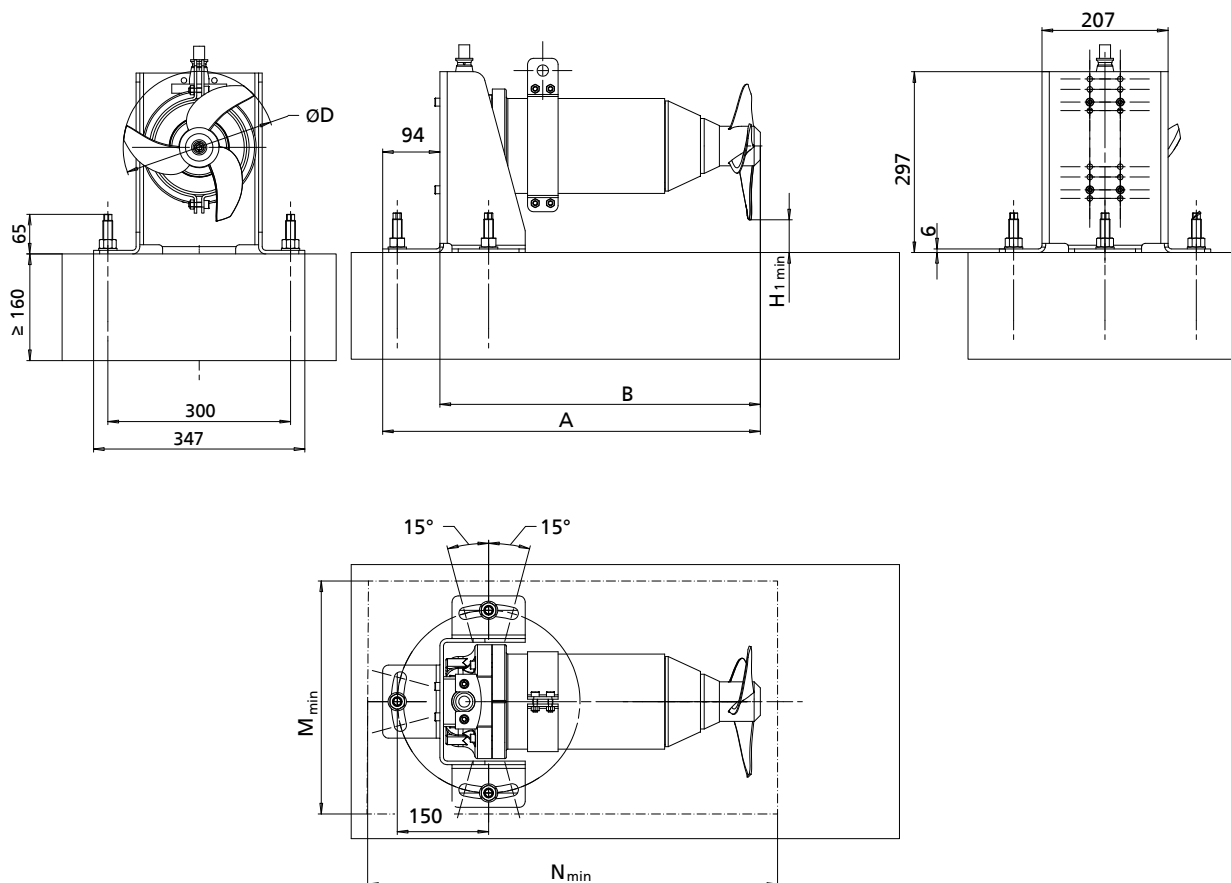


Fig. 20: Installation with accessories 6 - Amamix 200 / 300

Table 8: Dimensions [mm]

Ø D	H <sub>1 min</sub>	A	B	M <sub>min</sub>	N <sub>min</sub>
200	48,5	560	466	400	610
300	50	694	600	400	750

### 9.1.2 Installation of accessories 7 - Amamix 200 / 300

For mounting at the top and bottom of the tank wall, level-adjustable.

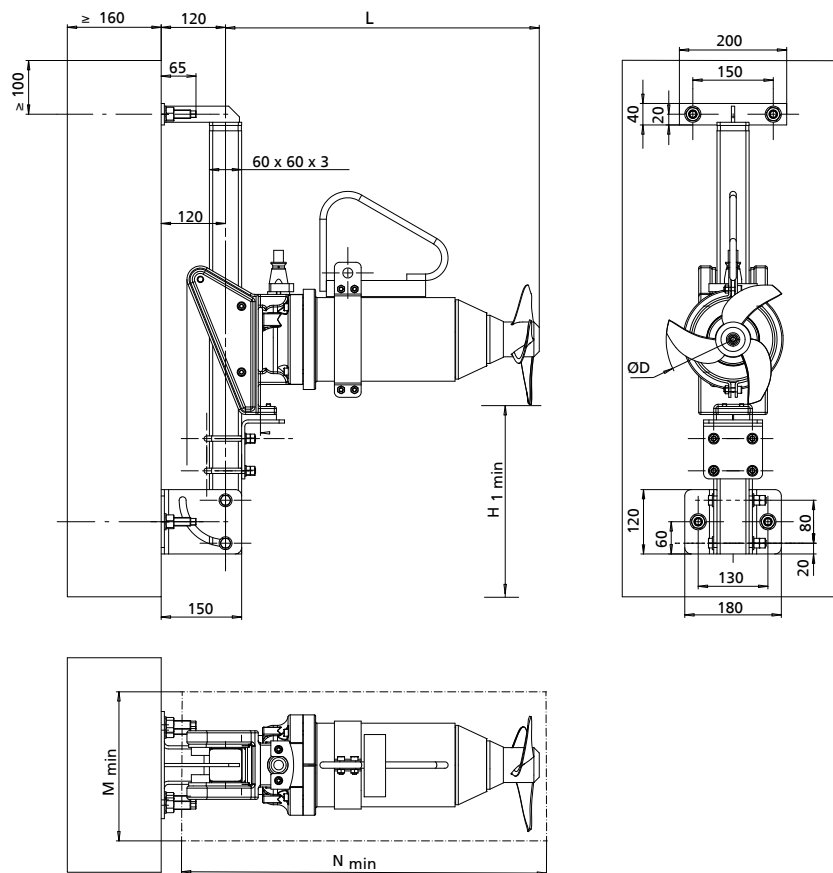


Fig. 21: Installation of accessories 7 - Amamix 200 / 300

Table 9: Dimensions [mm]

Ø D	Motor housing material	H <sub>1</sub>	L	M <sub>min</sub>	N <sub>min</sub>
200	G	120	524	275	700
200	C	120	520	275	700
300	G	150	659	375	830
300	C	150	655	375	830

### 9.1.3 Installation of accessories 7 - Amamix 200 / 300

For mounting at the top of the tank wall and on the benching, level-adjustable.

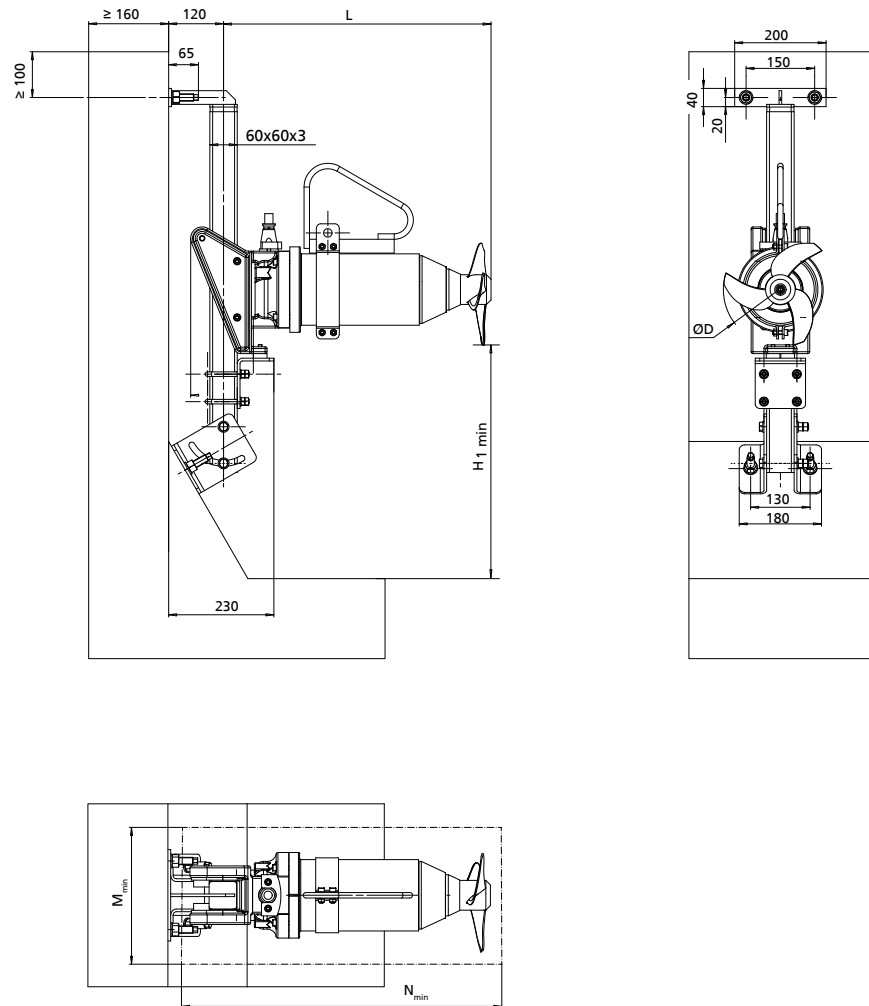



Fig. 22: Installation with accessories 7 - Amamix 200 / 300

Table 10: Dimensions [mm]

Ø D	Motor housing material	H <sub>1</sub>	L	M <sub>min</sub>	N <sub>min</sub>
200	G	120	524	275	700
200	C	120	520	275	700
300	G	150	659	375	830
300	C	150	655	375	830

### 9.1.4 Installation of accessories 22 - Amamix 200 / 300 / 400 (except size 4135)

For mounting at the top of the tank wall and on the tank floor, level-adjustable and with horizontal swivelling option.

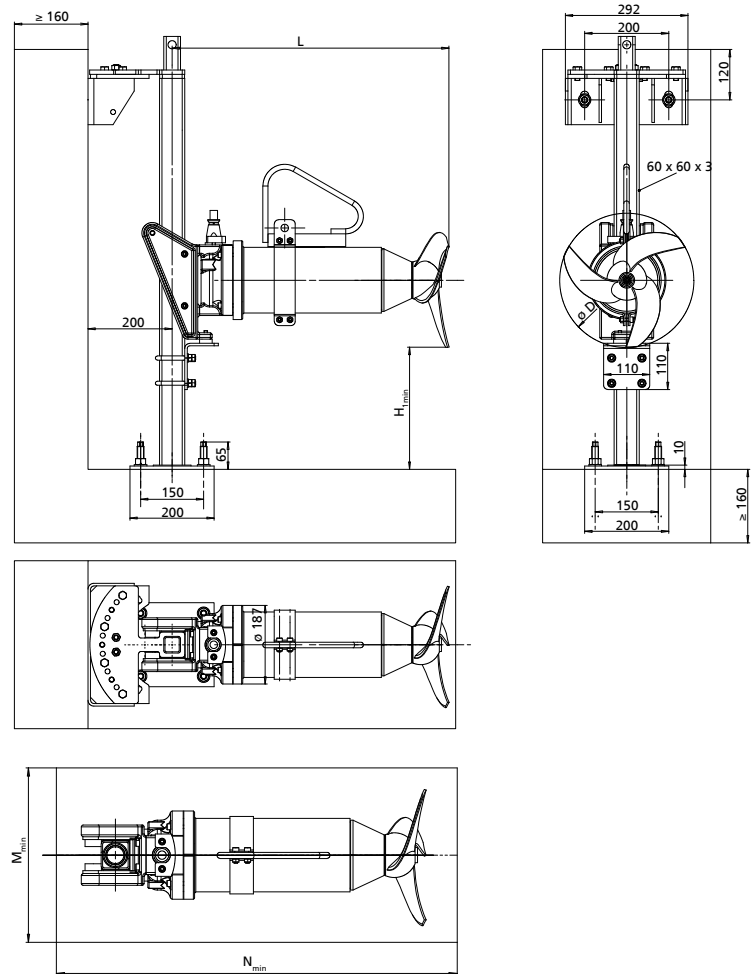

UG 1312313

Fig. 23: Installation with accessories 22 - Amamix 200 / 300 / 400 (except size 4135)

Table 11: Dimensions [mm]

Ø D	Motor housing material	H <sub>1 min</sub>	L	M <sub>min</sub>	N <sub>min</sub>
200	G	120	524	275	780
200	C	120	520	275	780
300	G	150	659	375	910
300	C	150	655	375	910
400	G	200	844	460	1050
400	C	200	844	460	1050

### 9.1.5 Installation of accessories 22 - Amamix 200 / 300 / 400 (except size 4135)

For mounting at the top of the tank wall and at the bottom of the tank wall or on an inclined floor (10° - 90°), level-adjustable and with horizontal swivelling option.

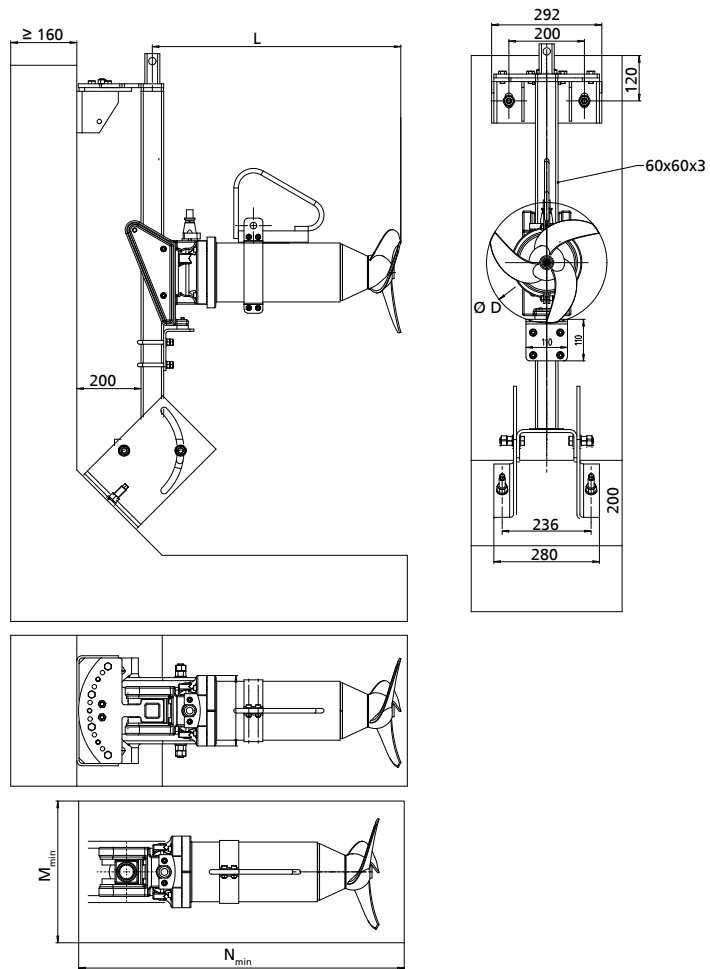


Fig. 24: Installation with accessories 22 - Amamix 200 / 300 / 400 (except size 4135)

Table 12: Dimensions [mm]

$\varnothing D$	Motor housing material	L	$M_{min}$	$N_{min}$
200	G	524	275	780
200	C	520	275	780
300	G	659	375	910
300	C	655	375	910
400	G	844	460	1050
400	C	844	460	1050

### 9.1.6 Installation of accessories 22 - Amamix 200 / 300 / 400 (except size 4135)

Middle support for guide rail 60 x 60 x 3, for large installation depths.

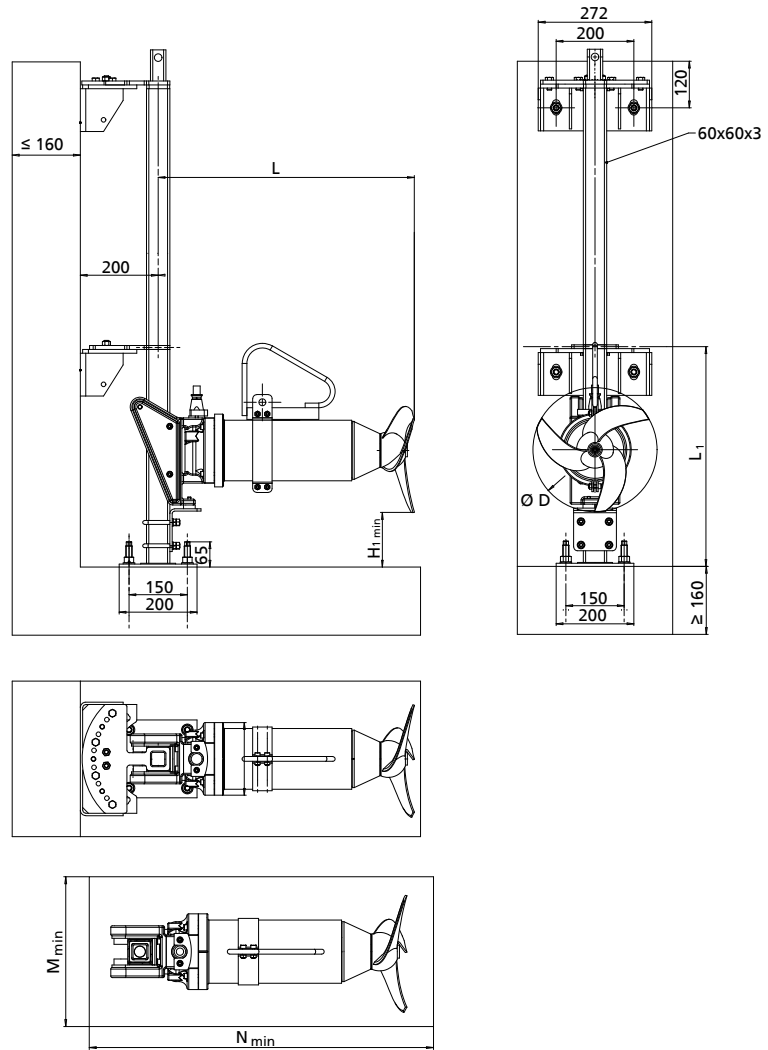


Fig. 25: Installation with accessories 22 - Amamix 200 / 300 / 400 (except size 4135)

Table 13: Dimensions [mm]

Ø D	Motor housing material	H <sub>1 min</sub>	L	M <sub>min</sub>	N <sub>min</sub>
200	G	120	524	275	780
200	C	120	520	275	780
300	G	150	659	375	910
300	C	150	655	375	910
400	G	200	844	460	1050
400	C	200	844	460	1050

### 9.1.7 Installation of accessories 22 - Amamix 400 (size 4135 only) / 600

For mounting at the top of the tank wall and on a horizontal tank floor, level-adjustable and with horizontal swivelling option.

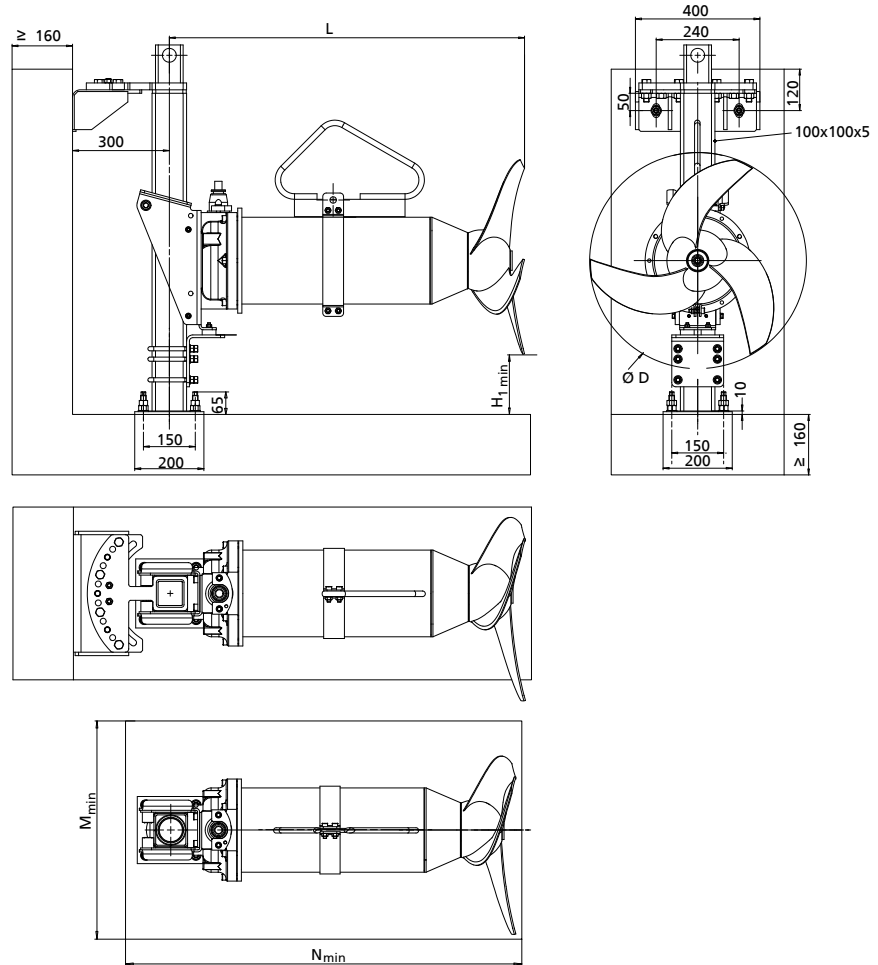


Fig. 26: Installation with accessories 22 - Amamix 400 (size 4135 only) / 600

Table 14: Dimensions [mm]

Ø D	Motor housing material	H <sub>1 min</sub>	L <sub>max</sub>	M <sub>min</sub>	N <sub>min</sub>
400	G	205	783	460	1150
400	C	205	780	460	1150
600	G	315	949	700	1310
600	C	315	949	700	1390



### 9.1.8 Installation of accessories 22 - Amamix 400 (size 4135 only) / 600

For mounting at the top of the tank wall and on a sloping tank floor ( $0.5^\circ - 10^\circ$ ), level-adjustable and with horizontal swivelling option.

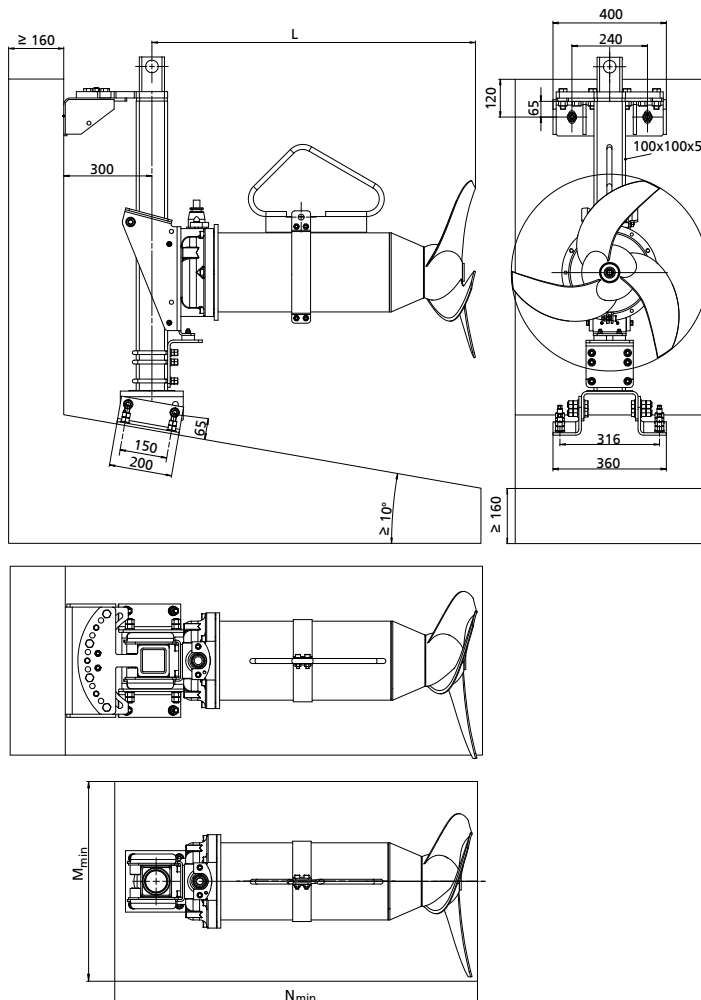


Fig. 27: Installation with accessories 22 - Amamix 400 (size 4135 only) / 600

Table 15: Dimensions [mm]

Ø D	Motor housing material	L	M <sub>min</sub>	N <sub>min</sub>
400	G	783	460	1150
400	C	780	460	1150
600	G	949	700	1310
600	C	949	700	1390

### 9.1.9 Installation of accessories 22 - Amamix 400 (size 4135 only) / 600

For mounting at the top of the tank wall and at the bottom of the tank wall or on an inclined floor

(10° - 90°), level-adjustable and with horizontal swivelling option.

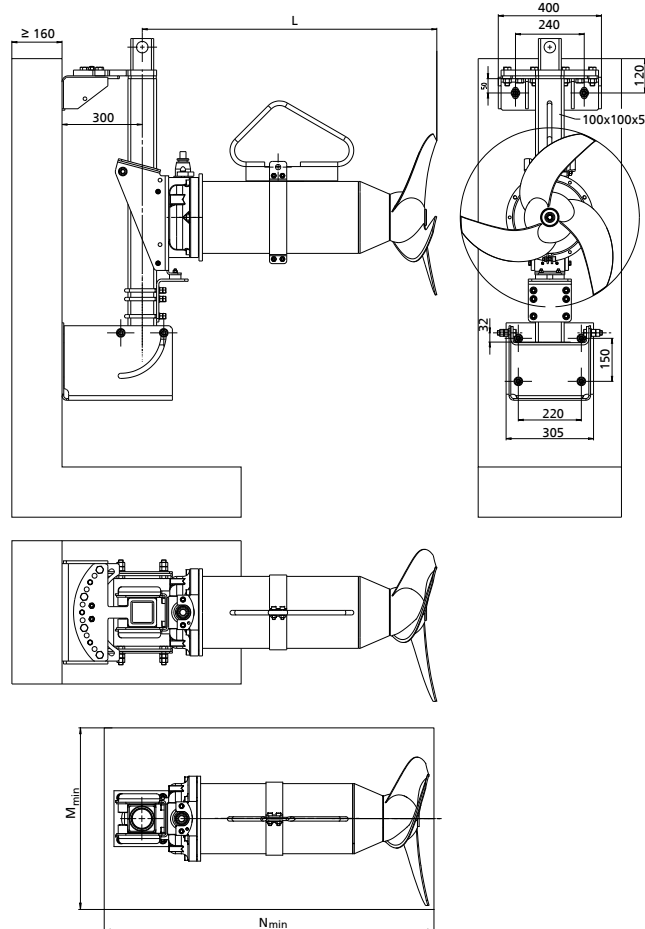


Fig. 28: Installation with accessories 22 - Amamix 400 (size 4135 only) / 600

Table 16: Dimensions [mm]

Ø D	Motor housing material	L	M <sub>min</sub>	N <sub>min</sub>
400	G	783	460	1150
400	C	780	460	1150
600	G	949	700	1310
600	C	949	700	1390

### 9.1.10 Installation of accessories 22 - Amamix 400 (size 4135 only) / 600

Middle support for guide rail 100 x 100 x 5, for large installation depths

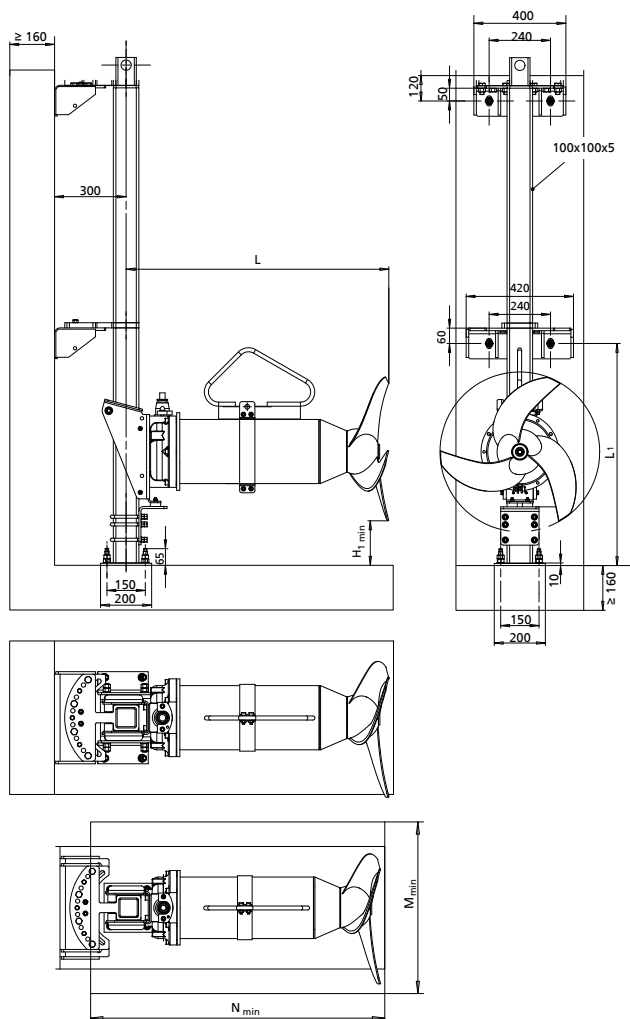


Fig. 29: Installation with accessories 22 - Amamix 400 (size 4135 only) / 600

Table 17: Dimensions [mm]

Ø D	Motor housing material	H <sub>1 min</sub>	L <sub>max</sub>	M <sub>min</sub>	N <sub>min</sub>
400	G	205	783	460	1150
400	C	205	780	460	1150
600	G	315	949	700	1310
600	C	315	949	700	1390

### 9.1.11 General arrangement drawing of accessories 22 - Amaprop 1000 and 1380

For mounting at the top of the tank wall and on a horizontal tank floor ( $0^\circ - 0.5^\circ$ ), level-adjustable and with horizontal swivelling option.


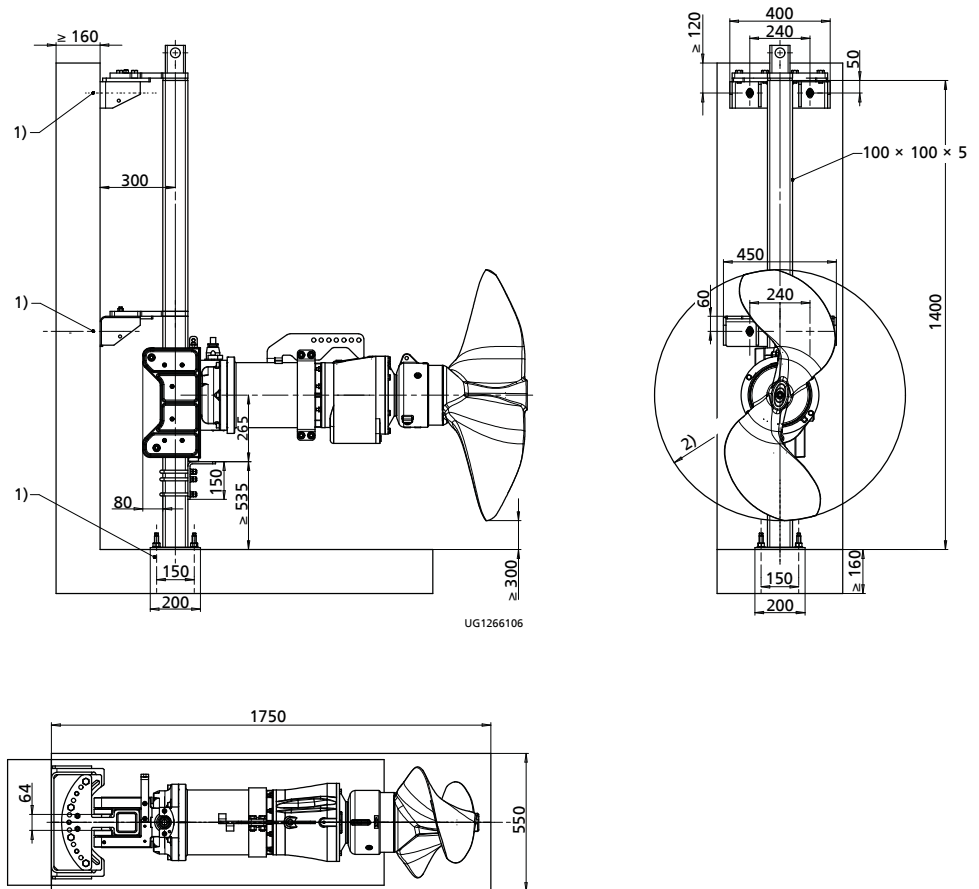


Fig. 30: Installation of accessories 22 - Amaprop 1000 and 1380

1)	Hole diameter = 18 mm, hole depth = 125 mm, max. tightening torque = 60 Nm
2)	Amaprop 1000: $\varnothing = 1000$ mm, Amaprop 1380: $\varnothing = 1380$ mm

### 9.1.12 General arrangement drawing of accessories 22 - Amaprop 1000 and 1380

For mounting at the top of the tank wall and on a sloping tank floor ( $0.5^\circ - 10^\circ$ ), level-adjustable and with horizontal swivelling option.

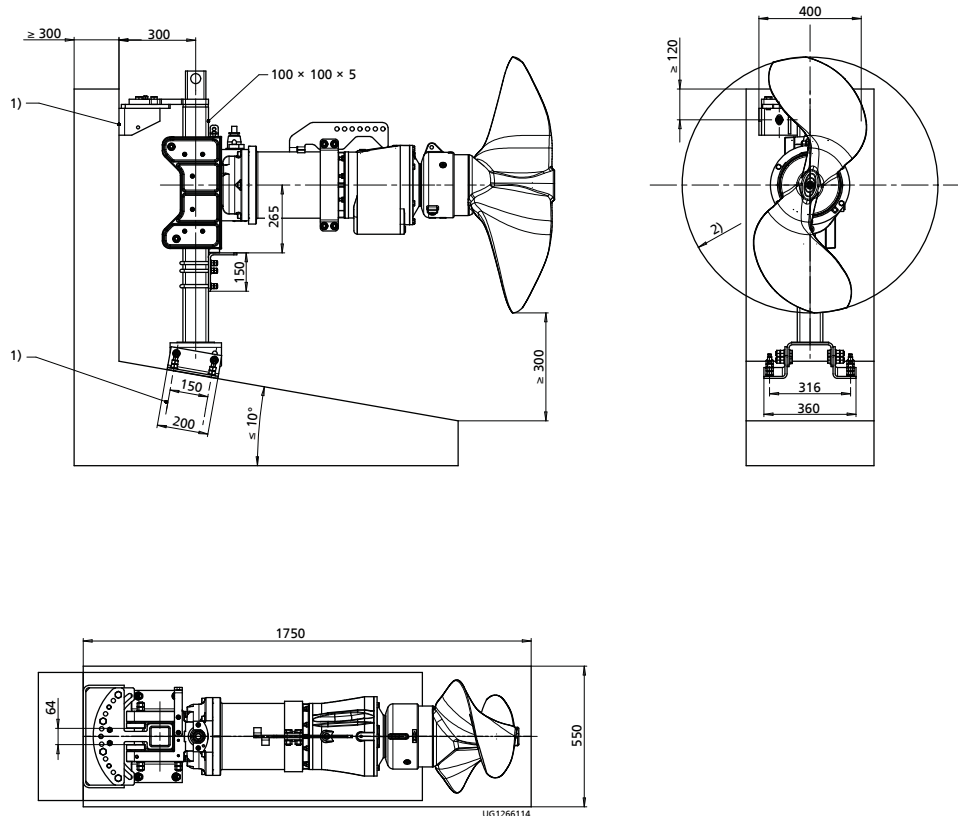

**Fig. 31:** Installation of accessories 22 - Amaprop 1000 and 1380

1)	Hole diameter = 18 mm, hole depth = 125 mm, max. tightening torque = 60 Nm
2)	Amaprop 1000: Ø 1000 mm, Amaprop 1380: Ø 1380 mm

### 9.1.13 Installation with upward pitch

For accessories 22 - Amamix 200 - 600

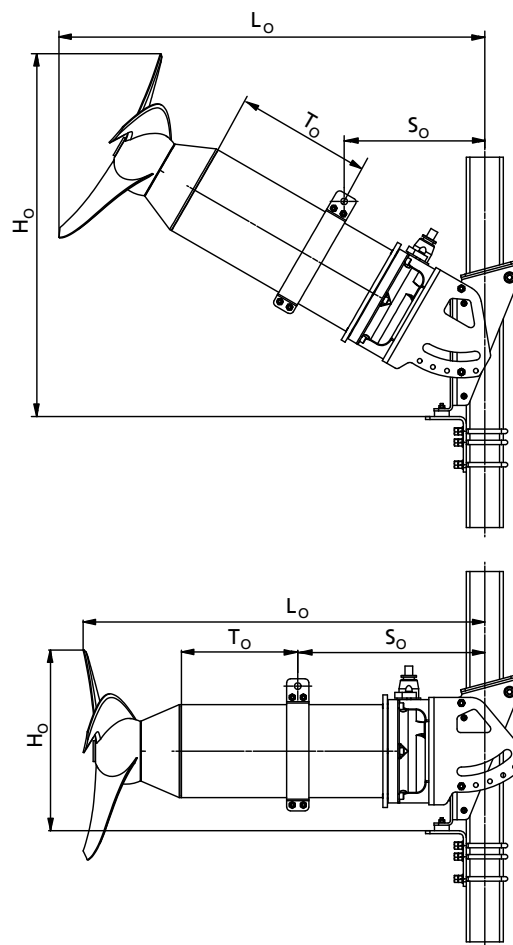


Fig. 32: Upward pitch adjustment

Table 18: Upward pitch adjustment by 0°, 10°, 20°, 30°, 40°

Size		Pitch = 0°				Pitch = 10°				Pitch = 20°				Pitch = 30°				Pitch = 40°			
		H <sub>o</sub>	L <sub>o</sub>	S <sub>o</sub>	T <sub>o</sub>	H <sub>o</sub>	L <sub>o</sub>	S <sub>o</sub>	T <sub>o</sub>	H <sub>o</sub>	L <sub>o</sub>	S <sub>o</sub>	T <sub>o</sub>	H <sub>o</sub>	L <sub>o</sub>	S <sub>o</sub>	T <sub>o</sub>	H <sub>o</sub>	L <sub>o</sub>	S <sub>o</sub>	T <sub>o</sub>
		[mm]																			
V2...	/ 1 4...	260	560	225	265	350	585	240	245	440	595	250	220	520	585	255	190	595	560	260	150
V2...	/ 2 4...	260	560	230	260	350	585	245	240	440	595	255	215	520	585	260	185	595	560	260	150
C2...	/ 1 4...	270	560	230	230	360	585	250	210	450	595	255	190	530	590	260	165	600	565	260	135
C2...	/ 2 4...	270	560	235	225	360	585	255	205	450	595	260	185	530	590	265	160	600	565	260	130
C29.../	/ 0 6...	313	709	275	255	470	744	295	230	570	759	315	200	655	754	315	170	735	729	305	140
C32...	/ 2 6...	313	709	275	255	470	744	295	230	570	759	315	200	655	754	315	170	735	729	305	140
C37.../	/ 3 8...	385	858	340	310	630	898	360	285	740	918	380	250	845	913	290	210	935	883	390	160
C41...	/ 4 8...	385	858	340	310	630	898	360	285	740	918	380	250	845	913	290	210	935	883	390	160
C57.../	/ 4 12...	530	1004	400	290	765	1074	425	260	890	1114	440	225	1000	1129	445	185	3)	3)	3)	3)
C63...	/ 8 12...	530	1129	460	350	785	1194	485	320	930	1229	500	280	1060	1234	505	235	3)	3)	3)	3)

Table 19: Upward pitch adjustment of 0°, 15°, 30°

Size		Pitch = 0°				Pitch = 15°				Pitch = 30°			
		H <sub>o</sub>	L <sub>o</sub>	S <sub>o</sub>	T <sub>o</sub>	H <sub>o</sub>	L <sub>o</sub>	S <sub>o</sub>	T <sub>o</sub>	H <sub>o</sub>	L <sub>o</sub>	S <sub>o</sub>	T <sub>o</sub>
		[mm]											
C57.../C63...	/ 6 12...	545	946	393	280	800	1079	400	250	1050	1116	360	230
	/ 10 12...	545	946	393	280	800	1079	400	250	1050	1116	360	230

<sup>3</sup> Max. permissible pitch: 30°

### 9.1.14 Installation with downward pitch

For accessories 22 - Amamix 200 - 600

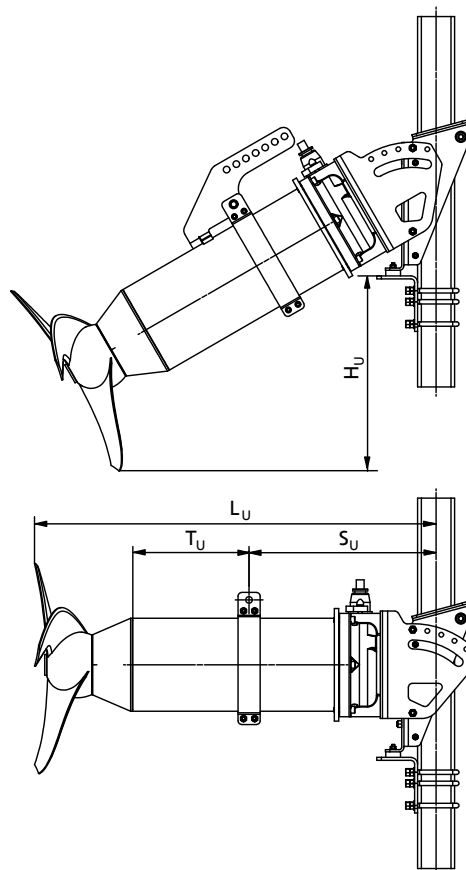


Fig. 33: Downward pitch adjustment

Table 20: Downward pitch adjustment by 0°, 10°, 20°, 30°, 40°

Size		Pitch = 0°				Pitch = 10°				Pitch = 20°				Pitch = 30°				Pitch = 40°			
		H <sub>U</sub>	L <sub>0</sub>	S <sub>U</sub>	T <sub>U</sub>	H <sub>U</sub>	L <sub>U</sub>	S <sub>U</sub>	T <sub>U</sub>	H <sub>U</sub>	L <sub>U</sub>	S <sub>U</sub>	T <sub>U</sub>	H <sub>U</sub>	L <sub>U</sub>	S <sub>U</sub>	T <sub>U</sub>	H <sub>U</sub>	L <sub>U</sub>	S <sub>U</sub>	T <sub>U</sub>
		[mm]																			
V2...	/ 1 4...	< 0	560	225	265	30	585	240	1.L	4)	4)	4)	4)	4)	4)	4)	4)	4)	4)	4)	4)
V2...	/ 2 4...	< 0	560	230	260	30	585	585	1.L	4)	4)	4)	4)	4)	4)	4)	4)	4)	4)	4)	4)
C2...	/ 1 4...	< 0	560	230	230	40	585	250	245	4)	4)	4)	4)	4)	4)	4)	4)	4)	4)	4)	4)
C2...	/ 2 4...	< 0	560	235	225	40	585	250	245	4)	4)	4)	4)	4)	4)	4)	4)	4)	4)	4)	4)
C29.../	/ 0 6...	13	709	275	255	150	744	285	280	245	759	285	305	335	754	285	2.L	415	729	270	4.L
C32...	/ 2 6...	13	709	275	255	150	744	285	280	245	759	285	305	335	754	285	2.L	415	729	270	4.L
C37.../	/ 3 8...	25	858	340	310	165	898	345	340	275	918	355	1.L	380	913	340	3.L	470	883	330	5.L
C41...	/ 4 8...	25	858	340	310	165	898	345	340	275	918	355	1.L	380	913	340	3.L	470	883	330	5.L
C57.../	/ 4 12...	100	1004	400	290	305	1074	415	325	430	1114	420	360	540	1129	420	390	5)	5)	5)	5)
C63...	/ 8 12...	100	1129	460	350	325	1194	475	385	470	1229	475	420	600	1234	470	455	5)	5)	5)	5)

Table 21: Downward pitch adjustment of 0°, 15°, 30°

Size		Pitch = 0°				Pitch = 15°				Pitch = 30°			
		H <sub>U</sub>	L <sub>U</sub>	S <sub>U</sub>	T <sub>U</sub>	H <sub>U</sub>	L <sub>U</sub>	S <sub>U</sub>	T <sub>U</sub>	H <sub>U</sub>	L <sub>U</sub>	S <sub>U</sub>	T <sub>U</sub>
		[mm]											
C57.../C63...	/ 6 12...	85	946	393	280	350	950	700	300	486	1048	579	320
	/ 10 12...	85	946	393	280	350	950	700	300	486	1048	579	320

<sup>4</sup> On request only

<sup>5</sup> Max. permissible pitch: 30°

## 10 Certificate of Decontamination

Type: .....  
Order number /  
Order item number<sup>6)</sup>: .....  
Delivery date: .....  
Application: .....  
Fluid handled<sup>6)</sup>: .....

Please tick where applicable<sup>6)</sup>:



Corrosive



Oxidising



Flammable



Explosive



Hazardous to health



Seriously hazardous to health



Toxic



Radioactive



Bio-hazardous



Safe

Reason for return<sup>6)</sup>: .....  
Comments: .....  
.....

The product / accessories have been carefully drained, cleaned and decontaminated inside and outside prior to dispatch / placing at your disposal.

We herewith declare that this product is free from hazardous chemicals and biological and radioactive substances.

For mag-drive pumps, the inner rotor unit (impeller, casing cover, bearing ring carrier, plain bearing, inner rotor) has been removed from the pump and cleaned. In cases of containment shroud leakage, the outer rotor, bearing bracket lantern, leakage barrier and bearing bracket or intermediate piece have also been cleaned.

For canned motor pumps, the rotor and plain bearing have been removed from the pump for cleaning. In cases of leakage at the stator can, the stator space has been examined for fluid leakage; if fluid handled has penetrated the stator space, it has been removed.

- ☐ No special safety precautions are required for further handling.  
☐ The following safety precautions are required for flushing fluids, fluid residues and disposal:

.....  
.....

We confirm that the above data and information are correct and complete and that dispatch is effected in accordance with the relevant legal provisions.

.....  
Place, date and signature

.....  
Address

.....  
Company stamp

<sup>6</sup> Required field



## Index

### C

Certificate of Decontamination 52

### D

Design 15

Disposal 12

### E

Explosion protection 20, 35

### F

Fastening 15

### I

Installation types 15

### K

Key to safety symbols/markings 6

### M

Maintenance 36

### O

Other applicable documents 6

### P

Preservation 10

### R

Return to supplier 11

### S

Safety 8

Safety awareness 9

Scope of supply 16

Storage 10

### T

Tightening torques 36

Transport 10

Trouble-shooting

Causes and remedies 37

### W

Warnings 6







**KSB SE & Co. KGaA**

Johann-Klein-Straße 9 • 67227 Frankenthal (Germany)

Tel. +49 6233 86-0

[www.ksb.com](http://www.ksb.com)

1592.8217/01-EN (05153058)